

M5-UNIT Series Terminal Block Signal Conditioners

ISOLATORS & SENSOR INPUTS

| Product name | Model |
|---|--------|
| Isolator | M5YV |
| Input Loop Powered Isolator | M5SN |
| Universal Transmitter (PC programmable) | M5XU |
| Signal Transmitter (PC programmable) | M5XV |
| Signal Transmitter | M5VS |
| Signal Transmitter (narrow span input) | M5MV |
| Signal Transmitter (high speed response) | M5VF |
| Signal Transmitter (high speed response 30 μsec.) | M5VF2 |
| Signal Transmitter (high dielectric strength) | M5VSH |
| Voltage Divider | M5VV |
| Thermocouple Transmitter | M5TS |
| TC/RTD Transmitter (PC programmable) | M5XTR |
| RTD Transmitter | M5RS |
| Potentiometer Transmitter | M5MS |
| Current Loop Supply (non-isolated) | M5D |
| Current Loop Supply | M5DY |
| Current Loop Supply (applicable to HART signal, opencircuit detection selectable) | M5DYH2 |
| Tachogenerator Transmitter | M5TG |
| AC Transmitter | M5AC |

FREQUENCY I/O

| Product name | Model |
|---|-------|
| Pulse Isolator | M5PP |
| Pulse Isolator | M5YPD |
| Frequency Transmitter | M5PA |
| Frequency Transmitter (PC programmable) | M5XPA |
| Encoder Speed Transmitter (PC programmable) | M5XRP |
| DC/Frequency Transmitter | M5AP |
| Pulse Scaler | M5PRU |

DC ALARMS

| Product name | Model |
|--------------|-------|
| DC Alarm | M5AVS |
| DC Alarm | M5SED |

• Specifications may vary depending on the model. For details, check the specification sheet.

FUNCTION MODULES

| Product name | Model |
|---|--------|
| Adder (PC programmable) | M5XADS |
| Subtractor (PC programmable) | M5XSBS |
| Multiplier (PC programmable) | M5XMLS |
| Divider (PC programmable) | M5XDIS |
| Ratio/Bias Transmitter (output bias, PC programmable) | M5XREB |
| Ratio/Bias Transmitter (input bias, PC programmable) | M5XRTS |
| Linearizer (PC programmable) | M5XF |
| Square Root Extractor (PC programmable) | M5XFLS |
| Inverted Output Transmitter (PC programmable) | M5XUDS |
| Ramp Buffer (PC programmable) | M5XCRS |
| Track/Hold (PC programmable) | M5XAMS |
| Peak Hold (PC programmable) | M5XPHS |
| High/Low Selector (PC programmable) | M5XSES |
| Parameter Generator (PC programmable) | M5XMST |

POWER TRANSDUCERS

| Product name | Model |
|---|--------|
| Multi Power Transducer (PC programmable, self-powered, support harmonic distortion) | M5XWTU |
| Multi Power Transducer (PC programmable, self-powered) | M5XWT |
| PT Transmitter (RMS sensing) | M5PT |
| CT Transmitter (RMS sensing) | M5CT |
| CT Transmitter (clamp-on current sensor) | M5CTC |

- **Universal power supply**
Supporting 100 to 240 V AC and 24 V DC
- **Reliable 3-port isolation**
3-port isolation between input, output, and power supply
- **Loop test output**
Simulated signals are output for operation testing without input signals. (PC programmable type only)

Multi Power Transducer

Power Monitoring of Existing Equipment

Compact module can be squeezed into a tight space inside existing distribution boards

Multi Power Transducer

As calls for becoming carbon neutral increase, visualization of CO₂ emissions intensity has become essential. **Multi Power Transducers**, thanks to their compact package, can fit into a tight space of both new and existing panels or manufacturing equipment. They realize easily a detailed energy consumption monitoring via Modbus communication.



Model: M50EXWTU

- Modbus communication
- CO₂ emissions (energy conversion value) can be calculated.
- Modbus plus two energy count pulse outputs
- Max. 480 V AC direct input
- Max. 4-circuit inputs for single-phase/2-wire system, max. 2-circuit inputs for single- or three-phase/3-wire system
- Supporting three-phase/4-wire system connection
- Equipped with OEL display

See Page 6-7 for detailed information

Model: M50XWTU

- Modbus communication
- CO₂ emissions (energy conversion value) can be calculated.
- Modbus plus two energy count pulse outputs
- Max. 480 V AC direct input
- Max. 4-circuit inputs for single-phase/2-wire system, max. 2-circuit inputs for single- or three-phase/3-wire system
- Supporting three-phase/4-wire system connection

See Page 6-7 for detailed information

Model: M5XWTU

- Modbus communication
- You can choose one of the following output options: Modbus communication, analog output, or energy count pulse/alarm output.
- Max. 240 V AC direct input
- 290 measured variables (three-phase/3-wire system)

Model: M5XWT

- Modbus communication
- Modbus communication output
- Max. 240 V AC direct input
- 104 measured variables except harmonic contents (three-phase/3-wire system)




Your local representative:

Installation


Compact size

Multi Power Transducers, featuring the 41 mm (1.61 in.) deep (55 mm or 2.17 in. for M50EXWTU), terminal block style housing, are suitable for installation in a tight space of breaker boxes or wall-mounted panels.

Multi Power Transducer can be retrofitted

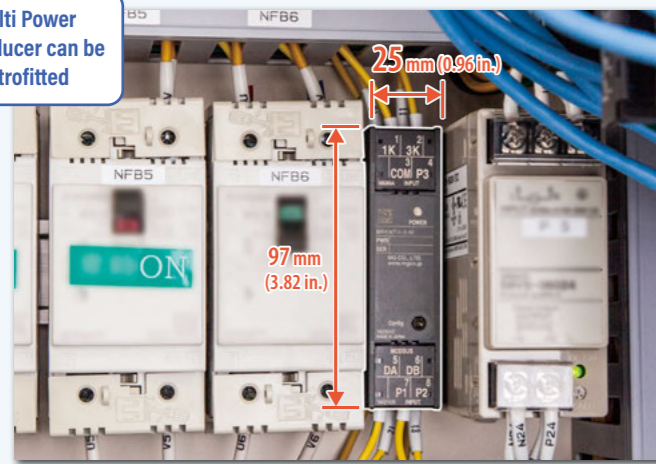

M5XWTU, M5XWT

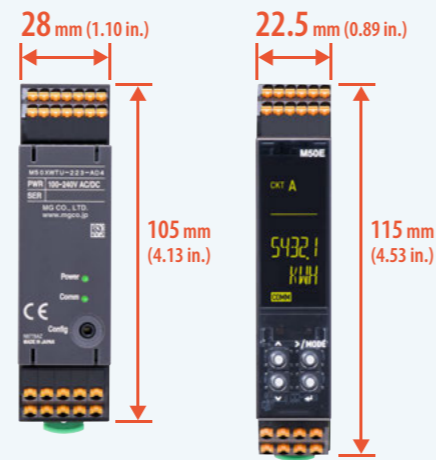

M50XWTU

M50EXWTU

Installation

Easy installation with clamp-on current sensors

The current inputs are connected in one touch by using **Clamp-on Current Sensors** (Model: CLSE), needing no live cable modification.

Furthermore, the M5XWTU and M5XWT use the voltage input to drive their internal circuits, needing no auxiliary power supply connection.

Clamp-on current sensors can be retrofitted with no power line modification

Open the clamp section.




Power line cable

Clamp the cable and close.



Power line cable

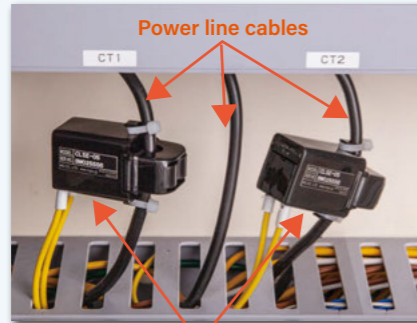


The current sensors can be installed without modifying existing power lines.



Easy Retrofitting
Clamp-on
Current Sensor
CLSE Series

Power line cable

Three-phase/4-wire connection for M50XWTU

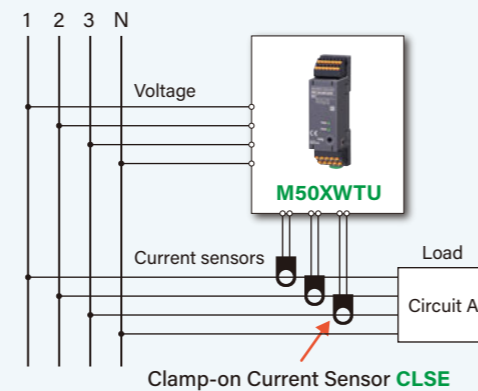

CLAMP-ON CURRENT SENSOR

The one-touch clamp-type sensor, incorporating a nylon spring, can be easily installed on existing equipment, such as distribution boards.

5 A, 50 A, 100 A, 200 A, 400 A, and 600 A types are available.


| Model | CLSE-R5 | CLSE-05 | CLSE-10 | CLSE-20 | CLSE-40 | CLSE-60 |
|--------------------------|--------------|--------------|--------------|--------------|--------------|--------------|
| Applicable wire diameter | 10 dia. max. | 10 dia. max. | 16 dia. max. | 24 dia. max. | 36 dia. max. | 36 dia. max. |
| Operational range | 5 A max. | 50 A max. | 100 A max. | 200 A max. | 400 A max. | 600 A max. |

Settings and Connection



Modbus communication

Modbus communication, convenient for remote energy monitoring by PLC or data loggers, is selectable as standard. Monitoring points can be easily added by daisy-chain wiring of twisted-pair cables.

Other output options such as analog signal, energy count pulse and alarm contact^(*) are also available for direct input to PLC/DCS.

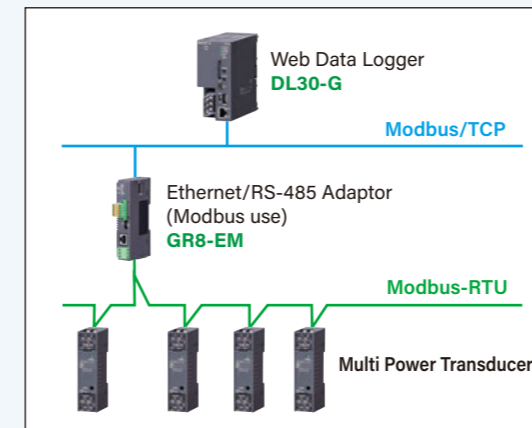

(*) Options for M5XWTU. Modbus only for M5XWT. Modbus plus energy count pulse signals are available for M50XWTU and M50EXWTU.
(*2) 104 variables for M5XWT (three-phase/3-wire), excluding harmonic contents.

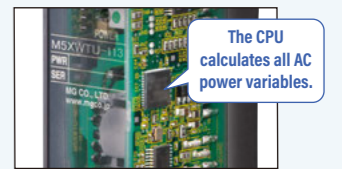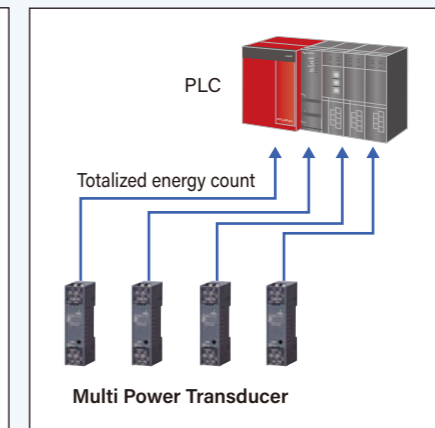

The CPU calculates all AC power variables.

The built-in CPU calculates the AC power variables instantaneously


The built-in CPU calculates instantaneously up to 290^{(*)2} variables for three-phase/3-wire system, including momentary values such as current, voltage, power, average values, maximum and minimum values, total harmonic distortion, and the 2nd to 31st harmonic contents, before updating the measured data in the memory every 500 milliseconds (approximate cycle).

Settings and Connection

Free setup software tool with convenient functions

The PC Configurator Software is used to set up various parameters of the **Multi Power Transducer**. It has a convenient monitoring window showing all measurement values in real time.


The loop test output mode, in which any output value can be simulated without actually connecting to active input circuits,

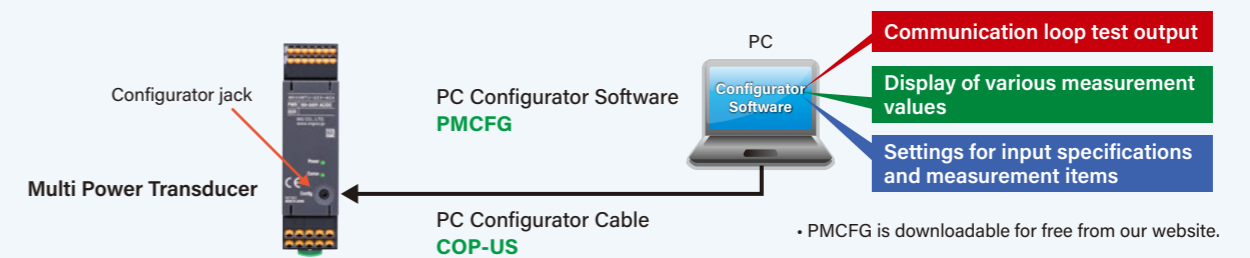


• PMCFG is downloadable for free from our website.

Useful Function

Setup via Modbus communication

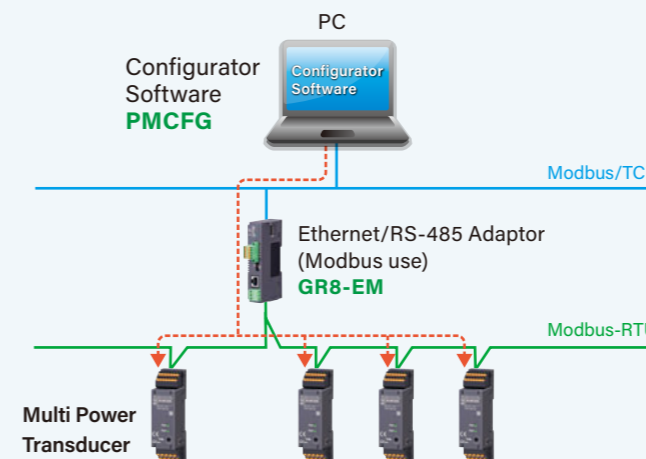

Using the PC Configurator Software to set the device address to the **Multi Power Transducer** in advance makes it possible to configure settings remotely via Modbus communication from a LAN-connected PC.

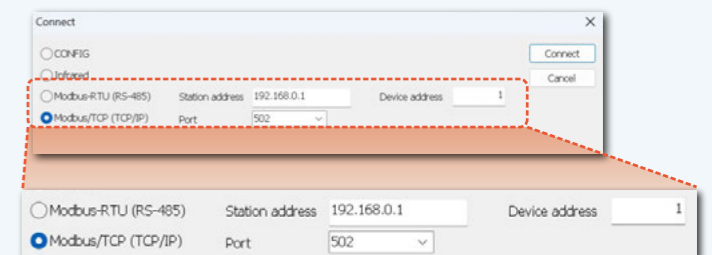

Built-in loop test output function

Loop test output mode in the PC Configurator Software can be used to simulate any output value without actually connecting to the active input circuits, which is useful for system commissioning.

| | Voltage | Frequency |
|-------|---------|-----------|
| 1-N | 200.02 | 50.00 |
| 2-N | 199.98 | |
| 3-N | 199.96 | |
| 1-2 | 346.45 | |
| 2-3 | 346.39 | |
| 3-1 | 346.45 | |
| Sigma | 346.41 | |


| | Current | Active power | React. power | App. power | Power factor | |
|-----------|---------|--------------|--------------|------------|--------------|--------|
| Circuit A | Sigma | 5.000 | 2569.7 | 1549.6 | 3000.8 | 0.8563 |
| | 1-N | 3.001 | 857.1 | 516.0 | 1000.4 | 0.8567 |
| | 2-N | 5.001 | 856.0 | 517.7 | 1000.4 | 0.8557 |
| | 3-N | 5.000 | 856.5 | 515.9 | 999.9 | 0.8566 |
| Circuit C | Sigma | 0.000 | 0.0 | 0.0 | 0.0 | 1.0000 |
| | 1-N | 0.000 | 0.0 | 0.0 | 0.0 | 1.0000 |
| | 2-N | 0.000 | 0.0 | 0.0 | 0.0 | 1.0000 |
| | 3-N | 0.000 | 0.0 | 0.0 | 0.0 | 1.0000 |

Unit: Voltage(V), Frequency(Hz), Current(A), Active power(W), React. power(var), App. power(VA), Power factor(cosφ)


Incorrect wiring and disconnection checking

The vector chart in the PC Configurator Software can be used to visually check for incorrect wiring and disconnections.

Correct wiring

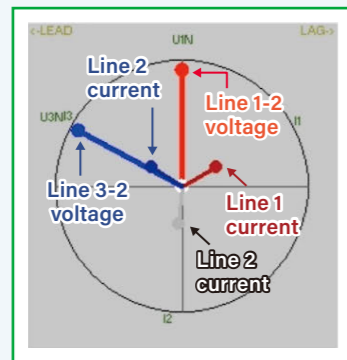

Incorrect wiring (example)

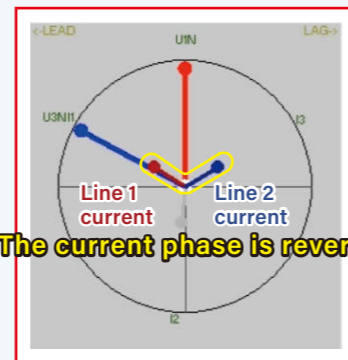

Convenient for periodic inspections

The PC Configurator Software makes it possible to record items that are not constantly monitored—such as harmonics and power factor—during periodic inspections, and the recorded data can then be used for predictive and preventive maintenance.

Monitoring window example (PC Configurator Model: PMCFG)


Monitoring window for M50XWTU

- Maximum and minimum values
- Energy and counter values
- CO₂ emissions (energy conversion value)
- All measurement data on PC screen!
- 2nd to 31st harmonic contents
- Harmonic distortion contents
- Vector Chart
- Voltage/current vector chart

You can start a single- or multi-point power monitoring system with the Modbus.


Precise power management is essential to achieving carbon neutrality. You can install the **Multi Power Transducers** in a small space, even on existing equipment. You can start with a small budget and gradually increase the number of measurement points, extending to overall management. For example, using **Web Data Logger** (Model: DL30-G) may be ideal as it enables Modbus communication at a reasonable cost.

System configuration example

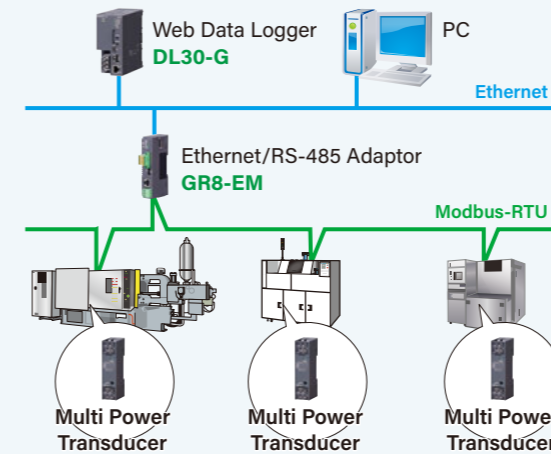


System configuration example for M50XWTU / M50EXWTU

CO₂ emissions can be calculated (energy conversion value)

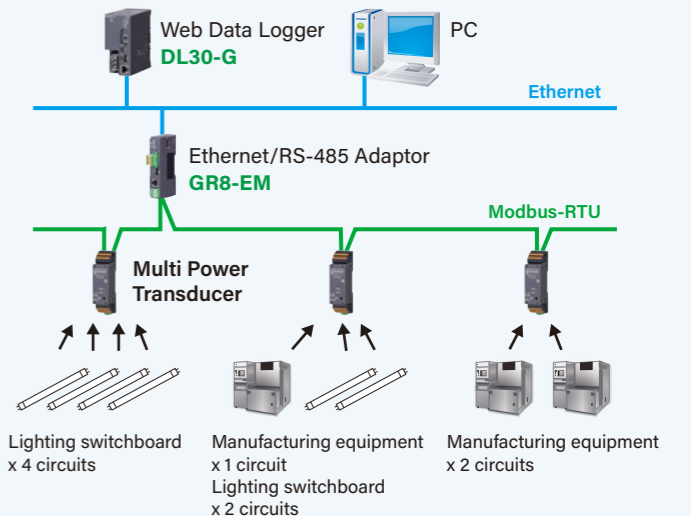

The **Wireless Gateway** allows the wireless transmission of the Modbus communication of the **Multi Power Transducers**.

System configuration example, wireless system

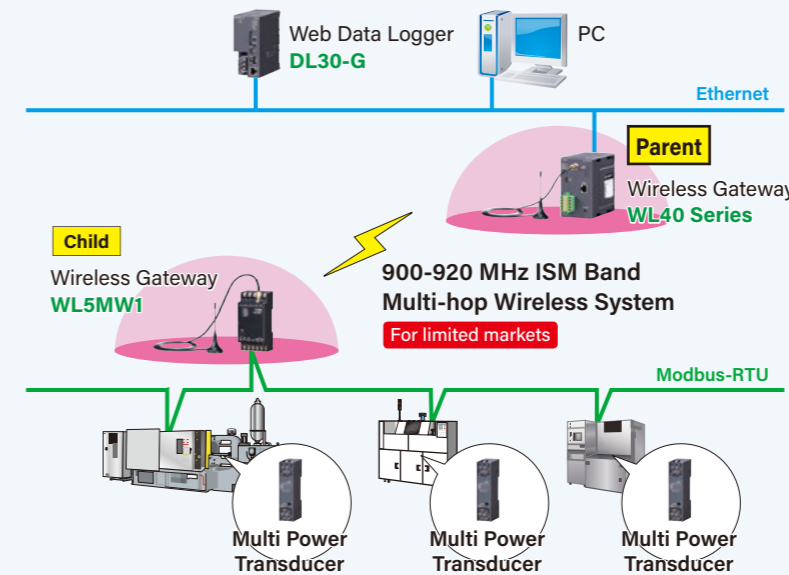

- #### Features of 900-920 MHz band
- Frequencies on the 900-920 MHz bands are highly diffractive and obstacle resistant.
 - A network is constructed with an exceptionally reliable multi-hop system.
 - Communication is available for a line-of-sight distance of up to 1 km.
 - No license application is required.
 - No communication wiring work is required.

920 MHz Band Multi-hop Wireless System

Child Wireless Gateway Model: WL5MW1

Limited to Japanese market



- Modbus-RTU transparent, 920 MHz band wireless gateway
- The gateway connects to Modbus remote I/Os and transfers Modbus-RTU protocol onto a wireless communication network.
- The compact terminal block style module can be installed in shallow panels such as breaker boxes and control panels on machines.

W45 x H97 x D41 mm (1.77" x 3.82" x 1.61")

M50XWTU / M50EXWTU with Universally Adaptable Features

Universally adaptable features including CE marking, 480 V AC input, and three-phase/4-wire configuration.


Multi-circuit measurement by single unit thanks to the tension-clamp terminal block with a large number of terminals.

FEATURES

- CO₂ emissions (energy conversion value) can be calculated.
- Max. 480 V AC direct input
- Three-phase/4-wire system input connection
- Max. 4-circuit inputs for single-phase/2-wire system, max. 2-circuit inputs for single- or three-phase/3-wire system by single module
- Two energy count pulse outputs
- High-contrast OEL display equipped on the M50EXWTU




Tension-clamp terminal block

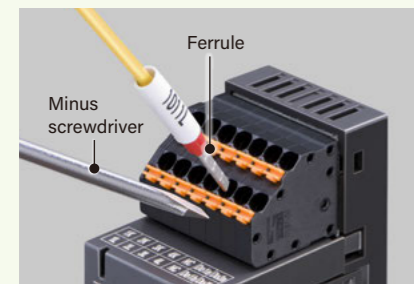

Wiring to the tension-clamp terminal block is quick and easy. Ferrules, solid or stranded wires of up to 1.5 mm² can be used.

Single module can measure up to 4 circuits! Space-saving and economical.

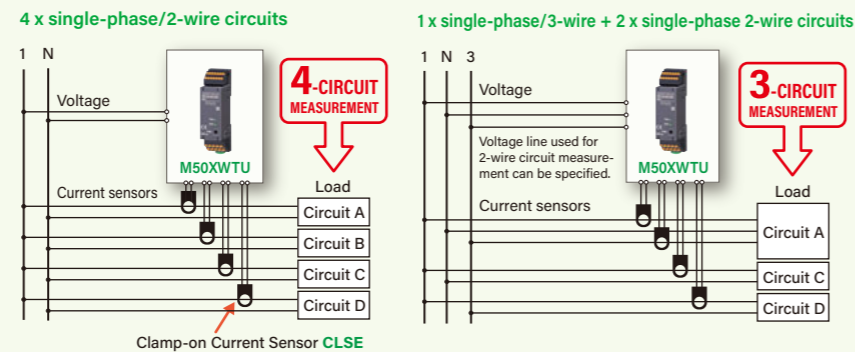




• Please see data sheet for more connection/application examples.

M50EXWTU: OEL display clearly displays information

The OEL display allows you to check the measured values of voltage, current, power, energy, CO₂ emissions (energy conversion value), and relative harmonic content of each element, as well as various setting values.

The display turns off if a set time elapses without any button operation. Just press any button while the display is off to return to the state before the display was turned off. You can also set the display to always be on.

Switching measured value display

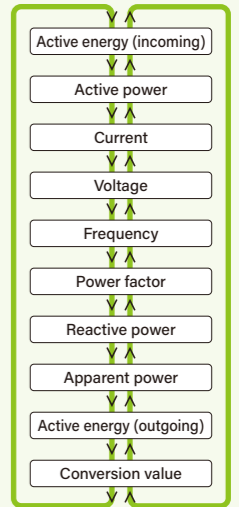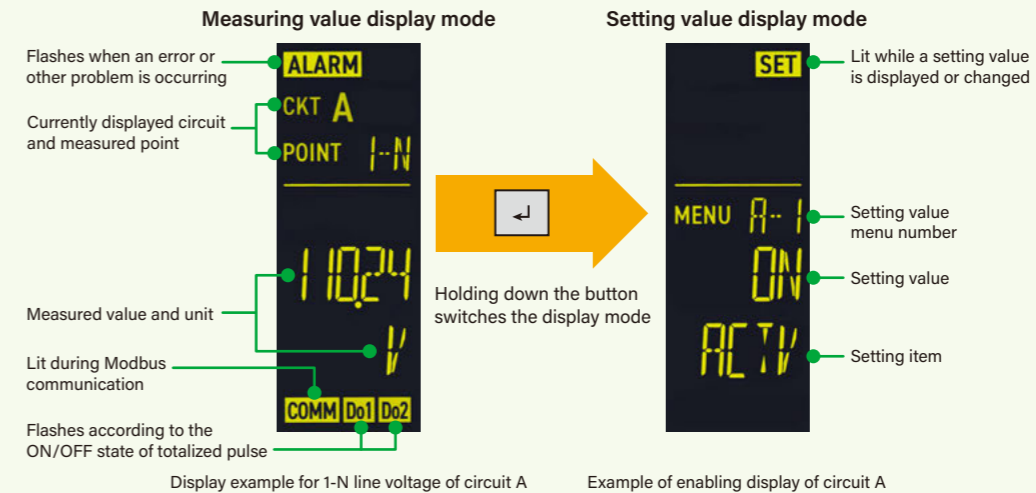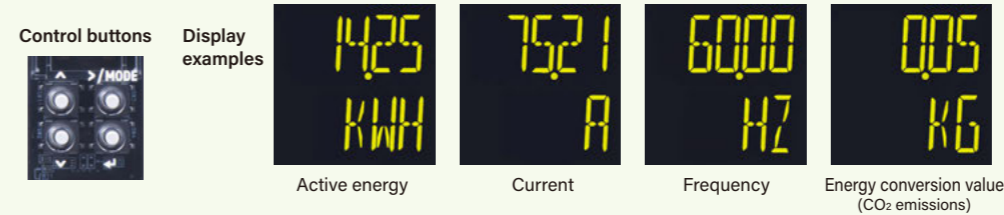

Introducing the UL-approved M50XWTU-U

UL-approved products are those that have been proved as meeting the safety standard requirements set by Underwriters Laboratories (UL) in the United States.

CLAMP-ON CURRENT SENSOR CLSE-U

The CLSE-U is an easily installable one-touch clamp-type sensor with a nylon spring, available in 5 A, 50 A, 100 A, 200 A, 400 A, and 600 A configurations.

| Model | CLSE-U-R5 | CLSE-U-05 | CLSE-U-10 | CLSE-U-20 | CLSE-U-40 | CLSE-U-60 |
|--------------------------|-------------|-------------|------------|------------|--------------|------------|
| Applicable wire diameter | 0.8-10 dia. | 2.5-10 dia. | 5-16 dia. | 8-24 dia. | 12.5-36 dia. | 17-36 dia. |
| Operational range | 5 A max. | 50 A max. | 100 A max. | 200 A max. | 400 A max. | 600 A max. |



Main specifications of the UL-approved M50XWTU-U

• See the latest specification sheet for more information.

INSTALLATION

This equipment can be mounted in customers' equipment and machine. The equipment cannot be mounted or retrofitted to switchboards, distribution boards, or control panels that are installed and in operating in a facility. The equipment must be installed such that appropriate clearance. (*)
 (*) Space 3 mm or more when placing this equipment side by side.

INSTALLATION SPECIFICATIONS

POWER INPUT
AC Power: 100 ~ 240 V AC
POWER CONSUMPTION
AC Power: ≤ 3 VA
Operating temperature:
-20 to +55°C (-4 to +131°F)

GENERAL SPECIFICATIONS

Applicable wire size (wire material: Copper):
 Lower connector (voltage input, power, Modbus) 0.2 - 1.5 mm²(AWG 16-24), stripped length 8 - 9 mm
 Upper connector (current sensor input, pulse output) 0.2 - 1.5 mm²(AWG 16-24), stripped length 10 - 11 mm

MODBUS COMMUNICATION

Standard: Conforms to TIA/EIA-485-A
Protocol: Modbus RTU

INPUT SPECIFICATIONS

240 V AC / CLSE-U
 Clamp-on current sensor is selectable from below.
 CLSE-U (5 A, 50 A, 100 A, 200 A, 400 A, 600 A)
 5A is available as CT's secondary.
• Voltage Input
Rated voltage for each wiring:
 •Phase voltage (1-N, 2-N, 3-N) 240 V AC
 •Line voltage (1-2, 2-3, 3-1) 240 V AC
Type for each wiring:
 •Single-phase/2-wire
 •Single-phase/3-wire
 •Three-phase/3-wire
 •Three-phase/4-wire
Input range:
 1-N, 2-N, 3-N 50 to 277 V AC
 1-2, 2-3, 3-1 50 to 277 V AC

Current Input

Current sensor (default: CLSE-U-R5)
 CLSE-U-R5: 0 - 5 A AC
 CLSE-U-05: 0 - 50 A AC
 CLSE-U-10: 0 - 100 A AC
 CLSE-U-20: 0 - 200 A AC
 CLSE-U-40: 0 - 400 A AC
 CLSE-U-60: 0 - 600 A AC
Selectable primary current range: 1 - 20 000 A
 (only with CLSE-U-R5, refer to the configurator settings)

OUTPUT SPECIFICATIONS

Pulse output
Outputs assignable to pulse:
 various energy
Output type: Photo MOSFET relay
Rated load: 30 V 200 mA AC/DC at peak

STANDARDS & APPROVALS


Approval:
 UL/C-UL general safety requirements
 (UL 61010-1, CAN/CSA-C22.2 No.61010-1)

Details of power data collected to reduce power consumption in automotive body painting processes.

The automotive body painting process involves several other processes, including operating the cranes, powering the electrolysis tanks, and drying. The customer needed to determine the actual power consumption in each process in order to review the overall power consumption. They decided to use the **Multi Power Transducer** (Model: **M5XWTU**), an ultra-compact device that can be installed in a tight space of equipment panels on site, in order to measure the power consumption in each process and collect this data through a higher-level PLC via an open network.


In addition, because monitoring temperatures and flow rates is important in the painting process, they also use the **R3 Series Remote I/O**, a multi-channel device with channel-to-channel isolation, to implement a comprehensive monitoring system.

The company plans to analyze the details of the collected power data and begin to reduce power consumption in the processes that are expected to have the greatest impact.

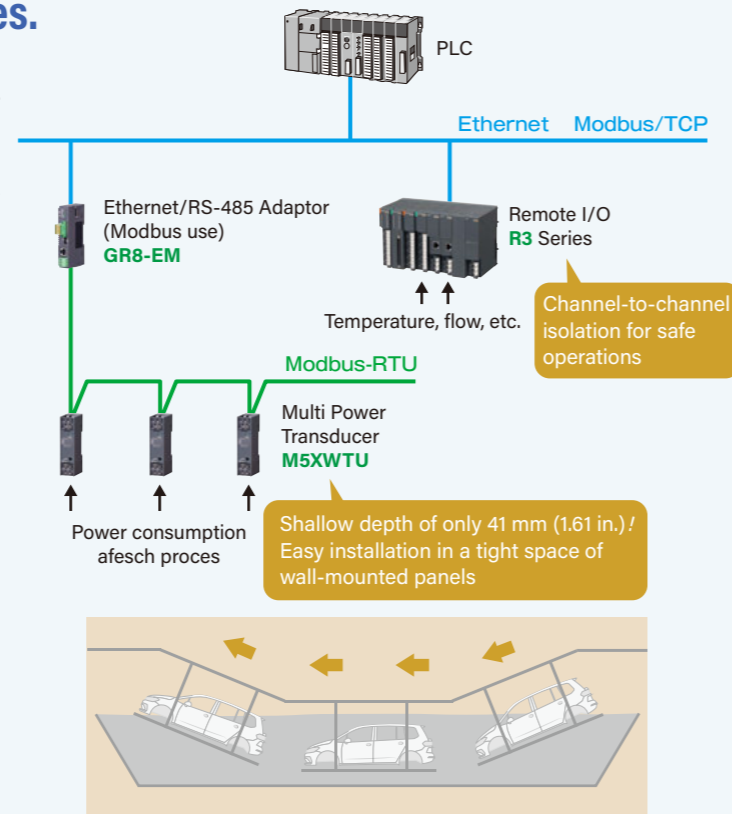


Power monitoring at the distribution board level was achieved with a Terminal Block Multi Power Transducer that allows direct input of 400 V lines.

Although power monitoring has conventionally tended to only be done at the factory's main switchboard, it was decided to consider more detailed monitoring at the distribution board level. Since some distribution boards had 400 V AC lines, we proposed an ultra-compact **Multi Power Transducer** that supports direct voltage input without using a voltage transformer, and can also be installed in the limited space of distribution boards. This proposal was well-received and adopted. Centralized monitoring is performed by collecting data from multiple monitoring points using Modbus communication.

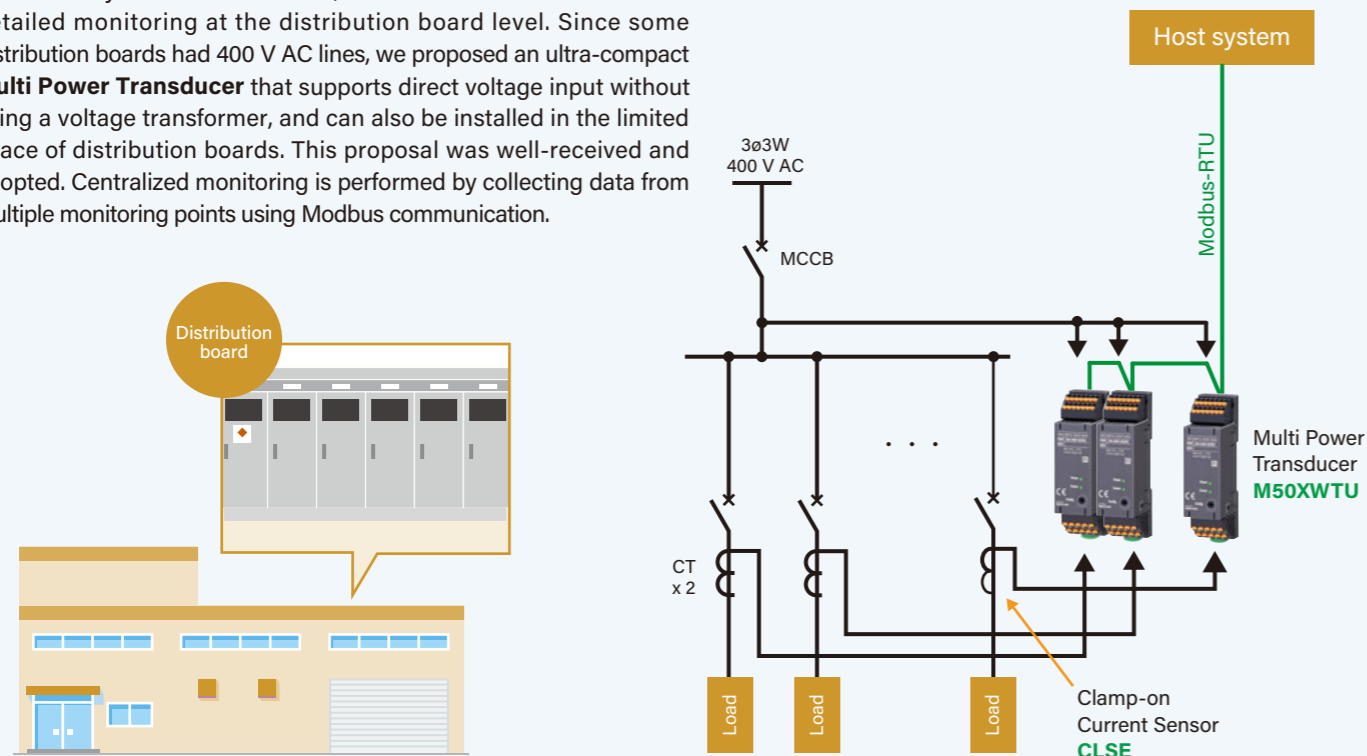

AC power monitoring at a metal materials factory


Web Data Logger collects various electric power measurements provided by the **Multi Power Transducer** and uses them to generate reports automatically. Report data can then be attached to an email and sent at specific intervals. **Web Data Logger** also acquires equipment information data from the PLC and, in the event of an equipment failure or other problem, sends the data as an email notification.



Web Data Logger DL8 Series

Web Data Logger is an on-site installable data logger with remote monitoring, data logging, and event reporting functions that can be accessed via a Web browser. It also includes a report function for generating reports.

Model: DL30

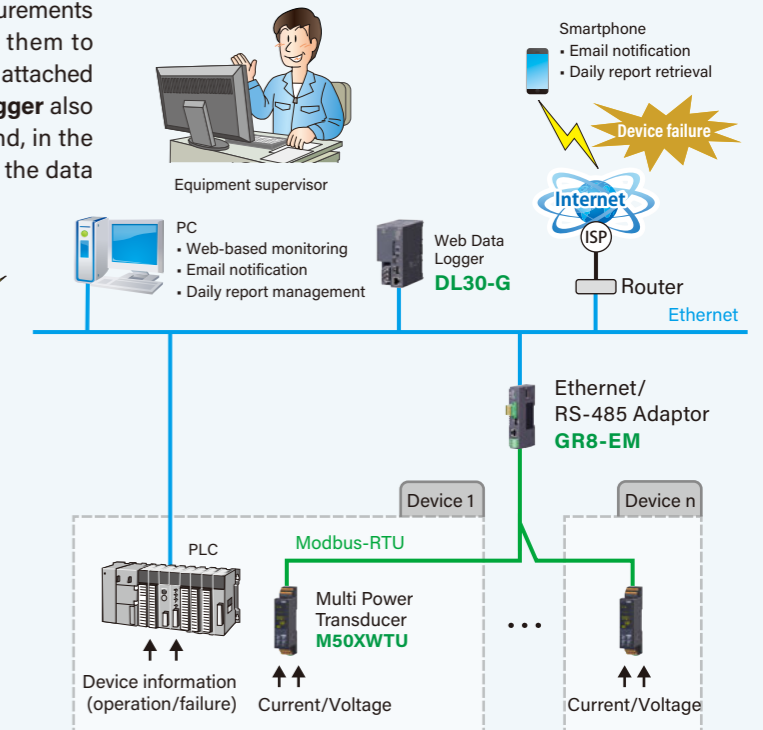

AC power monitoring of golf course watering equipment

By combining the **DL8 series**, **Multi Power Transducer**, and **ISM Band Multi-hop Wireless System**, it is possible to remotely monitor the AC power of equipment used to supply water to sprinklers and other devices. The monitoring window included with the **DL8 series** can be remotely monitored from anywhere using only a Web browser, and the system can automatically generate and email reports in the event of a malfunction.




Web Data Logger DL8 Series

The DL8 series is an IoT device with Web-based remote monitoring, data logging, and event reporting functions.

Model: DL8

DL8 simple Web server window

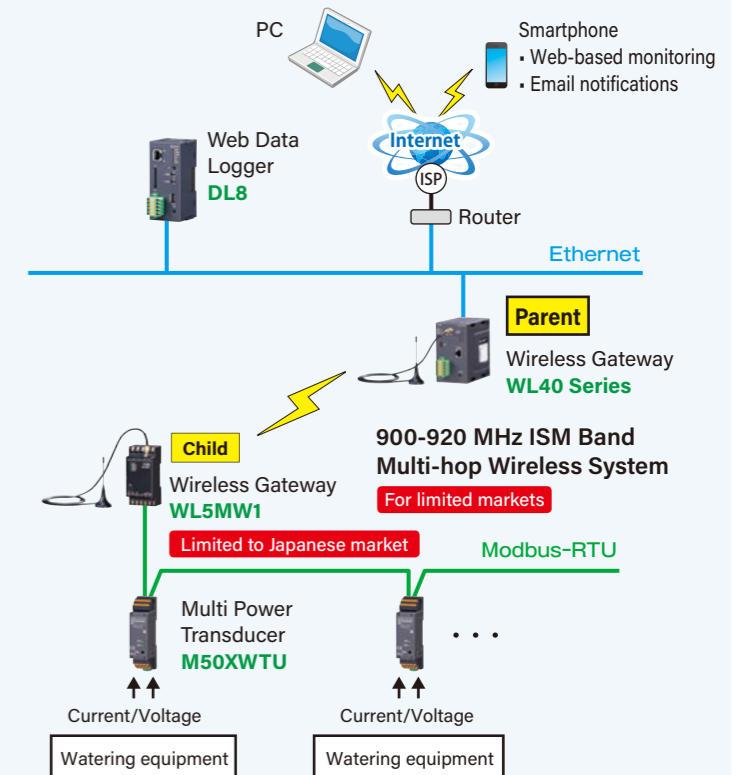

Specifications



W22.5 x H115 x D55 mm
(0.89" x 4.53" x 2.17")



W28 x H105 x D41 mm
(1.10" x 4.13" x 1.61")



W25 x H97 x D41 mm
(0.98" x 3.82" x 1.61")



W25 x H97 x D41 mm
(0.98" x 3.82" x 1.61")

| Product name | Multi Power Transducer (PC programmable) | | Multi Power Transducer (PC programmable, self-powered, supporting harmonic distortion) | | Multi Power Transducer (PC programmable, self-powered) | |
|-------------------------------|---|---------|--|-------|--|--|
| Model | M50EXWTU | M50XWTU | M5XWTU | M5XWT | | |
| Configuration | Single phase / 2-wire and 3-wire, 3-phase / 3-wire and 4-wire | | Single phase / 2-wire and 3-wire, 3-phase / 3-wire | | | |
| Construction | Terminal block | | Terminal block | | | |
| Connection | Tension clamp terminal | | M3.5 screw terminals (torque 0.8 N-m) | | | |
| Screw terminal | --- | | Nickel-plated steel (standard) or stainless steel | | | |
| Applicable wire size | Lower connector (voltage input, power, Modbus) 0.2 - 1.5 mm ² , stripped length 8 - 9 mm Upper connector (current sensor input, pulse output) 0.2 - 1.5 mm ² , stripped length 10 - 11 mm | | --- | | | |
| Housing material | Flame-resistant resin (black) | | Flame-resistant resin (black) | | | |
| Isolation | Voltage input or current input to Modbus to pulse output 1 to pulse output 2 to power | | Current input or voltage input to analog output or pulse output or Modbus | | Current input or voltage input to Modbus | |
| General Specifications | Voltage: 1-N, 2-N, 3-N, 1-2, 2-3, 3-1 Current: 1, 2, 3, N Active power Reactive power Apparent power Power factor Frequency | | Voltage: R-S, S-T, T-R Current: R, S, T Active energy: Incoming / outgoing Reactive energy: Incoming / outgoing / lag (inductive) / lead (capacitive) Harmonic distortion: Overall distortion ratio, content rate (2nd to 31st) Max. and min. values CO₂ emissions (energy conversion value) | | Voltage: R-S, S-T, T-R Current: R, S, T Active power Reactive power Apparent power Power factor Frequency Active energy: Incoming / outgoing | |
| Measured variables | Active energy: Incoming / outgoing Reactive energy: Incoming / outgoing / lag (inductive) / lead (capacitive) Harmonic distortion: Overall distortion ratio, content rate (2nd to 31st) Max. and min. values CO₂ emissions (energy conversion value) | | Harmonic distortion Overall distortion ratio, content rate (2nd to 31st) Voltage: R-S, S-T, T-R Current: R, S, T Max. and min. values | | Reactive energy: Incoming / outgoing / lag (inductive) / lead (capacitive) Apparent energy Average active power (demand) Average reactive power (demand) Average apparent power (demand) Average (demand) current: R, S, T | |
| Simplified measurement mode | Calculates power from current values with fixed voltage values and power factor. | | Calculates power from current values with fixed voltage values and power factor. | | | |
| Power indicator LED | --- | | Green LED; Blinking patterns indicate different operating status of the transducer. | | Green LED; Blinking patterns indicate different operating status of the transducer. | |
| Communication | Half-duplex, asynchronous, no procedure | | Half-duplex, asynchronous, no procedure | | | |
| Standard | Conforms to TIA/EIA-485-A | | Conforms to TIA/EIA-485-A | | | |
| Transmission distance | 500 meters max. | | 500 meters max. | | | |
| Baud rate | 1200, 2400, 4800, 9600, 19200, 38400 bps (default: 38400 bps) | | 1200, 2400, 4800, 9600, 19200, 38400 bps (default: 38400 bps) | | | |
| Protocol | Modbus-RTU | | Modbus-RTU | | | |
| Node address | 1 to 247 (default: 1) | | 1 to 247 (default: 1) | | | |
| Parity | None, even or odd (default: odd) | | None, even or odd (default: odd) | | | |
| Stop bit | 1 or 2 (default: 1) | | 1 or 2 (default: 1) | | | |
| Max. number of nodes | 31 (excluding master) | | 31 (excluding master) | | | |
| Transmission media | Shielded twisted-pair cable (CPEV-S 0.65-0.9 dia.) | | Shielded twisted-pair cable (CPEV-S 0.9 dia.) | | Shielded twisted-pair cable (CPEV-S 0.9 dia.) | |
| Internal terminating resistor | 110 Ω | | 110 Ω | | 110 Ω | |
| Communication indicator LED | --- | | Green LED turns ON while Modbus communication | | --- | |
| Frequency | 50 / 60 Hz (45 - 66 Hz) | | 50 / 60 Hz (45 - 66 Hz) | | 50 / 60 Hz (45 - 66 Hz) | |
| Input/Output Specifications | <ul style="list-style-type: none"> Voltage Input Rated voltage for each wiring Single-phase/2-wire: rated voltage 240 V AC Single-phase/3-wire: phase voltage 240 V AC / line voltage 480 V AC Three-phase/3-wire: line voltage 240 V AC (480 V AC when voltage to ground for each line is ≤ 277 V) Three-phase/4-wire: phase voltage 277 V / line voltage 480 V AC Input range: 1-N, 2-N, 3-N: 50 to 277 V AC 1-2, 2-3, 3-1: 50 to 480 V AC Consumption VA: Voltage circuit ≤ ULN² / 250 kΩ / ph Selectable primary voltage range: 50 - 400 000 V Current Input CLSE-R5: 0 - 5 A AC CLSE-05: 0 - 50 A AC CLSE-10: 0 - 100 A AC CLSE-20: 0 - 200 A AC CLSE-40: 0 - 400 A AC CLSE-60: 0 - 600 A AC Input range: 0 - 120% of the rating Low-end cutout (current): 0 - 99.9% (default setting: 1%) Selectable primary current range: 1 - 20 000 A (only with CLSE-R5, refer to the configurator settings) | | <ul style="list-style-type: none"> Voltage Input Rated voltage: 240 V AC Input range: 80 - 260 V AC (Phase voltage range is 80 - 130 V for single-phase/3-wire) Consumption VA: P1 - P2: ≤ 3 VA (power consumption of internal circuit) P2 - P3: voltage² / ≤ 1.5MΩ VA Selectable primary voltage range: 50 - 400 000 V Current Input CLSE-R5: 0 - 5 A AC CLSE-05: 0 - 50 A AC CLSE-10: 0 - 100 A AC CLSE-20: 0 - 200 A AC CLSE-40: 0 - 400 A AC CLSE-60: 0 - 600 A AC Input range: 0 - 120% of the rating Low-end cutout (current): 0 - 99.9% (default setting: 1%) Selectable primary current range: 1 - 20 000 A (only with CLSE-R5, refer to the configurator settings) | | <ul style="list-style-type: none"> Voltage Input Rated voltage: 240 V AC Input range: 80 - 260 V AC (Phase voltage range is 80 - 130 V for single-phase/3-wire) Consumption VA: P1 - P2: ≤ 3 VA (power consumption of internal circuit) P2 - P3: voltage² / ≤ 1.5MΩ VA Selectable primary voltage range: 50 - 400 000 V Current Input CLSE-R5: 0 - 5 A AC CLSE-05: 0 - 50 A AC CLSE-10: 0 - 100 A AC CLSE-20: 0 - 200 A AC CLSE-40: 0 - 400 A AC CLSE-60: 0 - 600 A AC Input range: 0 - 120% of the rating Low-end cutout (current): 0 - 99.9% (default setting: 1%) Selectable primary current range: 1 - 20 000 A (only with CLSE-R5, refer to the configurator settings) | |
| | <ul style="list-style-type: none"> Pulse output Outputs assignable to pulse: various energy Output type: Photo MOSFET relay Rated load: 30 V 200 mA AC/DC at peak ON resistance: 1 Ω max. Leakage current during opening: 2 μA max. | | <ul style="list-style-type: none"> Analog output Default setting is DC current output 4 - 20 mA Types DC current output: 0 - 20 mA DC DC voltage output: -10 - +10 V DC DC voltage output: -5 - +5 V DC (3 types can be switched by DIP switch and PC) Outputs: Voltage, current, various powers, power factor, frequency, harmonic current and harmonic voltage • DC current output range 0 - 20 mA DC Output available range: 0 - 23 mA DC Minimum span: 1 mA Load resistance: 550 Ω • DC voltage output range -10 - +10 V DC Output available range: -11.5 - +11.5 V DC Minimum span: 1 V Load resistance: Output drive 1 mA max. (e.g. When 0 - 10 V DC, 10 V÷1 mA = 10kΩ) | | <ul style="list-style-type: none"> DC voltage output range -5 - +5 V DC Output available range: -5.75 - +5.75 V DC Minimum span: 500 mV Load resistance: Output drive 1 mA max. (e.g. When 1 - 5 V DC, 5 V÷1 mA = 5000Ω) Pulse / alarm output Outputs assignable to pulse: various energy Outputs assignable to alarm: Voltage, current, various powers, power factor, frequency, various energy average, current average, harmonic current and harmonic voltage Output type: Photo MOSFET relay Rated load: 160 V 150 mA AC/DC at peak ON resistance: 8 Ω max. Leakage current during opening: 2 μA max. | |
| Operating temperature | -20 to +65°C (-4 to +149°F) | | -20 to +65°C (-4 to +149°F) | | -20 to +65°C (-4 to +149°F) | |
| Operating humidity | 30 to 90 %RH (non-condensing) | | 30 to 90 %RH (non-condensing) | | 30 to 90 %RH (non-condensing) | |
| Atmosphere | No corrosive gas or heavy dust | | No corrosive gas or heavy dust | | No corrosive gas or heavy dust | |
| Mounting | DIN rail | | DIN rail | | DIN rail | |
| Weight | 90 g (2.8 oz) | | 70 g (2.5 oz) | | 80 g (2.8 oz) | |
| Power consumption | AC: Max. 3 VA (100 - 240 V AC) / DC: ≤ 1.5 W (100 - 240 V DC) [universal] | | --- | | --- | |
| Performance | Accuracy (*3) Voltage: ±0.5 % (*4) Current: ±0.5 % (*4) Power: ±0.5 % (*4) Power factor: ±1.5 % Frequency: ±0.1 Hz Energy: ±2 % (power factor ≥ 0.5, input ≥ 10%) | | Temp. coefficient: ±0.0075 %/°C (0.004 %/°F) Sampling time: ≤ 500 msec. Insulation resistance: ≥ 100 MΩ with 500 V DC Dielectric strength: 2000 V AC @ 1 minute (current input or voltage input to Modbus to pulse output 1 to pulse output 2 to power) (M50XWTU) 2000 V AC @ 1 minute (current input or voltage input to Modbus to pulse output 1 or pulse output 2 to power) (M50EXWTU) 500 V AC @ 1 minute (pulse output 1 to pulse output 2) (M50EXWTU) | | Accuracy (*3) Voltage: ±0.5 % (*5) Current: ±0.5 % (*5) Power: ±0.5 % (*5) Power factor: ±1.5 % Frequency: ±0.5 Hz Energy: ±2 % (power factor ≥ 0.5, input ≥ 10%) | |
| | | | Analog output accuracy (*6) Temp. coefficient: ±0.0075 %/°C (0.004 %/°F) Sampling time: ≤ 500 msec. Analog output response time: ≤ 1.5 sec. (0 to 99%) Insulation resistance: ≥ 100 MΩ with 500 V DC Dielectric strength: 2000 V AC @ 1 minute (current input or voltage input to analog output or pulse output or Modbus to ground) | | Temp. coefficient: ±0.0075 %/°C (0.004 %/°F) Sampling time: ≤ 500 msec. Insulation resistance: ≥ 100 MΩ with 500 V DC Dielectric strength: 2000 V AC @ 1 minute (current input or voltage input to Modbus to ground) | |

(*3) Sensor error margin not included. Add sensor error margin when using the combination of the sensor.

(*4) An accuracy for rated input. The described accuracy levels are ensured at the input 1% or more for neutral current in a single-phase/3-wire circuit, phase-2 current in a 3-phase/3-wire circuit and phase-N current in a 3-phase/4-wire circuit.

(*5) An accuracy for rated input. The described accuracy levels are ensured at the input 1% or more for neutral current in a single-phase/3-wire circuit and phase-S current in a 3-phase/3-wire circuit.
 (*6) Output accuracy for the setting value span is shown as following formula.
 Output accuracy = (output range ÷ output setting value span) × 0.02% For current output: Output accuracy = (output range ÷ output setting value span) × 0.04%
 [Ext] DC current output 4 - 20 mA: Output accuracy = (20 mA ÷ 16A) × 0.04% = 0.05% Input accuracy and sensor error are added to total accuracy.