

Model M3LU / M3LU2 Universal Transmitter
PC CONFIGURATOR SOFTWARE
Model: M3LUCFG

USERS MANUAL

CONTENTS

1. GETTING STARTED	4
1.1. PC REQUIREMENTS.....	4
1.2. INSTALLING & DELETING THE PROGRAM	4
1.3. STARTING UP THE M3LUCFG.....	5
1.4. OPTION /A & OPTION /B.....	5
1.5. APPLICABLE MODELS OF THE M3LUCFG	5
2. MONITOR.....	6
2.1. STARTING UP	6
2.2. CONNECTING THE DEVICE.....	7
2.3. MONITORING TRENDS.....	8
2.3.1. DEVICE MODE.....	9
2.3.2. DEVICE STATUS	9
2.3.3. BARGRAPH & TREND GRAPH	10
3. CONFIGURATION.....	11
3.1. INPUT CONFIGURATION.....	11
3.2. DETAILED INFORMATION.....	12
3.3. ANALOG OUTPUT	14
3.4. ADC CONVERSION RATE.....	15
4. ONE STEP CALIBRATION	16
4.1. INPUT CALIBRATION MODE.....	17
4.2. OUTPUT CALIBRATION MODE.....	18
5. INPUT / OUTPUT CALIBRATION	19
5.1. DAC TRIMMING	19
5.1.1. LOWER RANGE DAC TRIMMING.....	19
5.1.2. UPPER RANGE DAC TRIMMING	19
5.1.3. RESETTING TO THE DEFAULT	19
5.2. SENSOR CALIBRATION.....	20
6. OFFLINE CONFIGURATION AND READ / WRITE FILES	21
6.1. CUSTOM TC.....	21
6.1.1. USER-SPECIFIC TC TABLE.....	21
6.1.2. CUSTOM TC WINDOW	22
6.2. CUSTOM RTD.....	24
6.2.1. USER-SPECIFIC RTD TABLE	24
6.2.2. CUSTOM RTD WINDOW.....	25
6.3. LINEARIZATION TABLE	27
6.3.1. LINEARIZATION TABLE SETTING.....	27
6.3.2. SPECIAL CURVE	28

6.4. FILE MANAGEMENT	30
6.4.1. MODIFYING PARAMETERS	31
6.4.2. TRANSFERRING DATA TO/FROM DEVICE	32
6.4.3. READING/WRITING FILES	33
6.4.4. COMPARING FILE TO DEVICE.....	34
6.4.5. OPERATION EXAMPLE BY FILE MANAGEMENT	35
7. DIAGNOSTICS	37
8. LANGUAGE.....	38

1. GETTING STARTED

1.1. PC REQUIREMENTS

The following PC performance is required for adequate operation of the M3LUCFG.


OS	Windows 10 (32-bit, 64-bit) Windows 11 (64-bit) The software may not operate adequately in certain conditions.
CPU/Memory	Must meet the relevant Windows' requirements.
Hard disk	10MB minimum free space
PC configurator cable	Model COP-US (USB) or MCN-CON (RS-232-C)

1.2. INSTALLING & DELETING THE PROGRAM

INSTALL

The program is provided as compressed archive. Decompress the archive and execute 'setup.msi' to start up the M3LUCFG installer program. Follow instructions on the Windows.

In the M3LUCFG installer program, all the software of the M3CFG series will be installed. If you would like to install only M3LUCFG, change to "X" for other software in the window appeared during the installation as shown below.

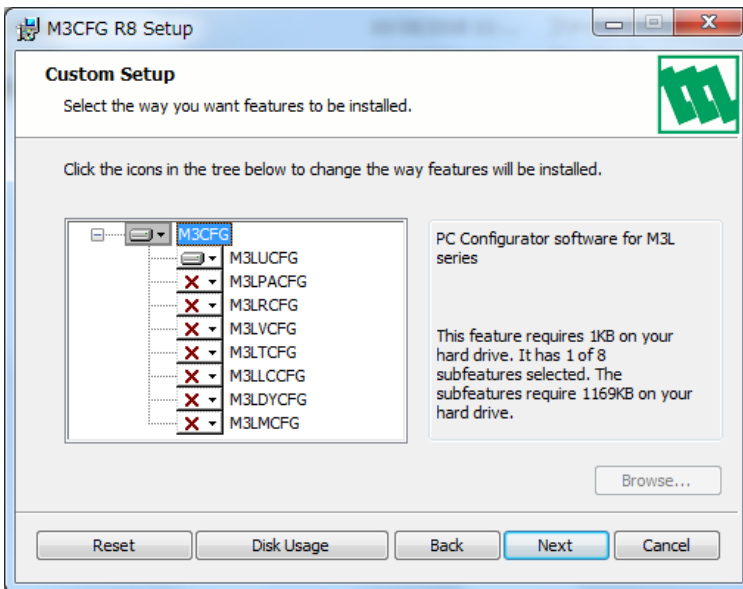

DELETE

Open Control Panel > Add/Remove Programs. Select the "M3CFG Rx" from the program list and click Delete button.

1.3. STARTING UP THE M3LUCFG

Connect the model M3LU Universal Transmitter to the PC via the PC configurator cable.

Press Start on the task bar and choose M3CFG > M3LUCFG from the Program menu.

1.4. OPTION /A & OPTION /B

The M3LU with Option /B is not designed for PC configuration, while the Option /A version is fully programmable on the PC.

When you connect the Option /B version to the PC and start up the M3LUCFG program, you can confirm the current setting but these buttons and fields used for configuring the module are greyed out and thus unavailable.

The M3LUCFG features available for the Option /B version are: Monitoring, One Step Calibration, DAC Trimming and Fixed Output.

1.5. APPLICABLE MODELS OF THE M3LUCFG

The M3LU and M3LU2 are configurable with the M3LUCFG. In this document it is mentioned about the M3LU setting procedure, the same explanation can be also used for the M3LU2.


2. MONITOR

2.1. STARTING UP

Figure 1 shows the initial window of the M3LUCFG PC Configurator window.

In order to enable the tools shown on the screen, the model M3LU Universal Transmitter must be connected to the PC via the PC configurator cable.


Figure 1. Initial Window

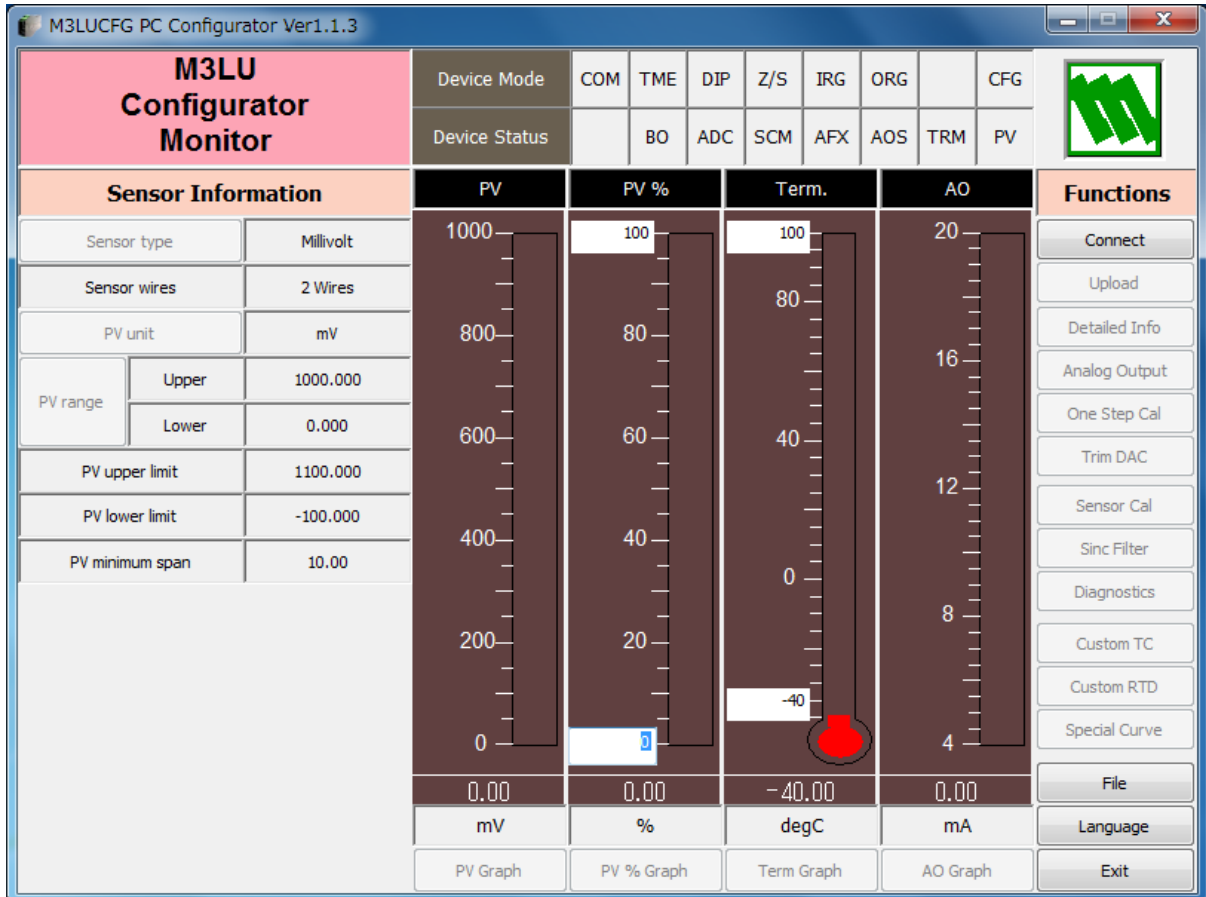

2.2. CONNECTING THE DEVICE

On the initial window, click [Connect] and the Device Connection menu appears on the screen.

Figure 2. Device Connection

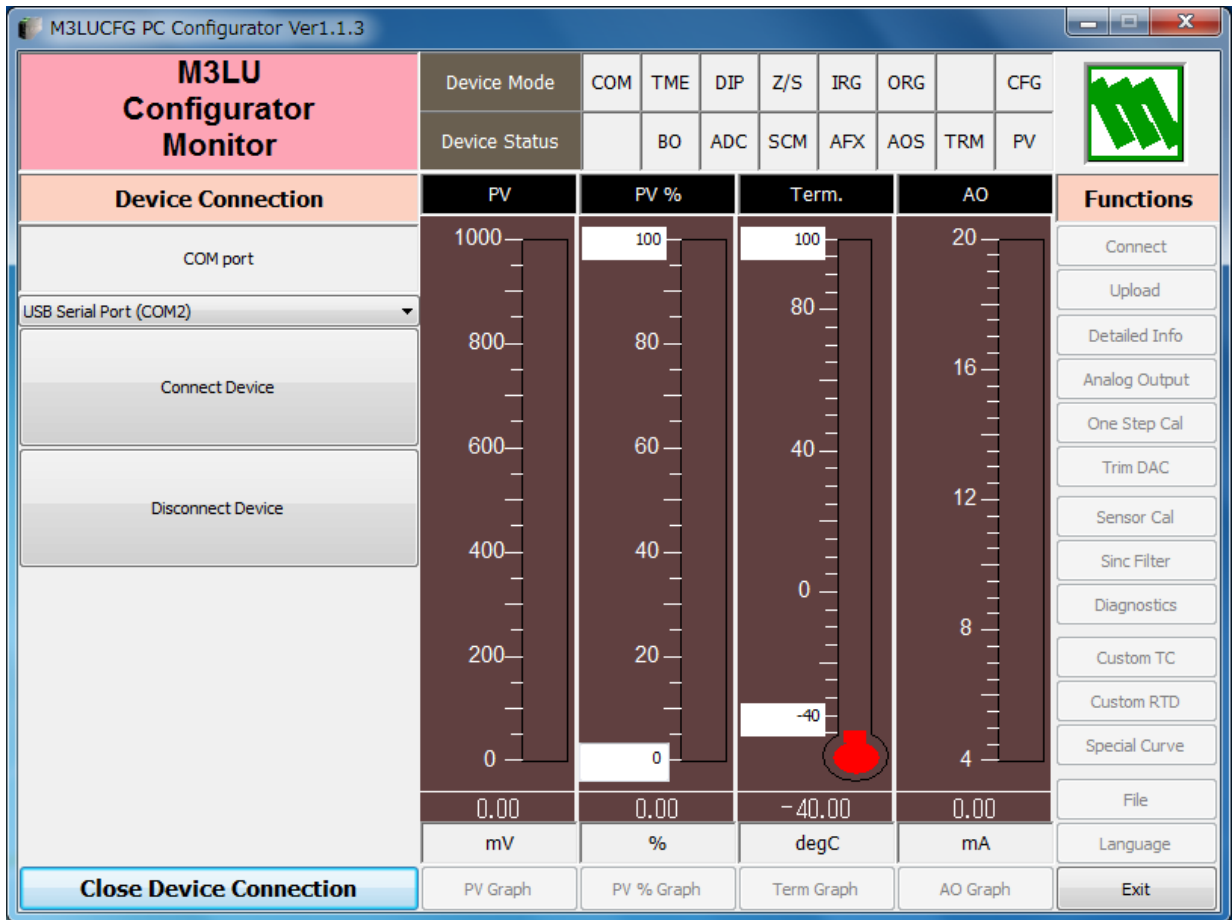


COM port	Choose an adequately configured COM port to be connected.
Connect Device	Connects the device. Once the connection is established, the program uploads the device's configuration information and automatically opens Sensor Information window. The window is the base for various operations to configure the M3LU.
Disconnect Device	Disconnects the currently connected device.
Close Device Connection	Close the Device Connection window.

2.3. MONITORING TRENDS

Once the device is connected, the Sensor Information menu and the trend monitors appears on the screen. The user can configure various parameters of the M3LU.

Use [Upload] button to re-load device information e.g. when you replace the module with a new one or when you make changes to M3LU's configuration without using this tool.

Figure 3. Sensor Information

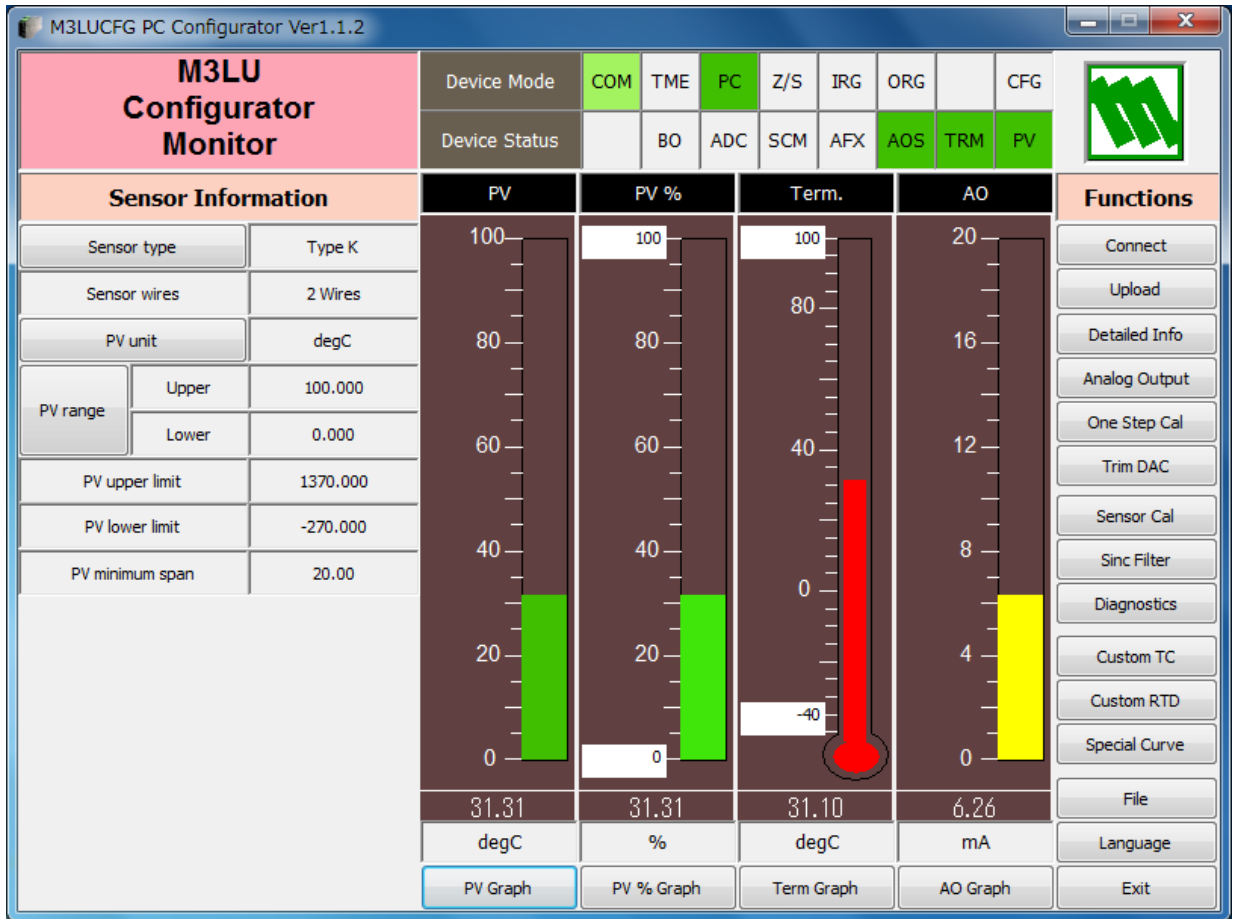

2.3.1. DEVICE MODE

Device Mode summarizes the device's current operation status and communications status with the PC by lamps.

Device Mode	COM	TME	PC	Z/S	IRG	ORG		CFG
-------------	-----	-----	----	-----	-----	-----	--	-----

or

Device Mode	COM	TME	DIP	Z/S	IRG	ORG		CFG
-------------	-----	-----	-----	-----	-----	-----	--	-----

[COM] lamp	Blinks with the normal communications condition.
[TME] lamp	Red light turns on when the device detects the communications time out.
[DIP]/[PC] lamp	Shows the device's configuration mode: DIP switch or PC. For the M3LU version /B, only DIP switch mode is available.
[Z/S] lamp	Red light turns on when the device is in the DAC trimming mode.
[IRG] lamp	Red light turns on when the device is in the input one-step calibration mode.
[ORG] lamp	Red light turns on when the device is in the output one-step calibration mode.
[CFG] lamp	Red light turns on when data changes have been done on the configuration software since it was stored the last time. It turns off once the data has been stored into the nonvolatile memory.

2.3.2. DEVICE STATUS

Device Status summarizes the current device status by lamps.

Device Status		BO	ADC	SCM	AFX	AOS	TRM	PV
---------------	--	----	-----	-----	-----	-----	-----	----

[BO] lamp	Red light turns on with 'Burnout' detected (temperature sensor's wire breakdown or ADC overrange).
[ADC] lamp	Red light turns on with ADC's hardware errors.
[SCM] lamp	Red light turns on with the device's internal communication errors.
[AFX] lamp	Red light turns on when the analog output entered in Fixed AO mode.
[AOS] lamp	Green light turns on when the analog output is diagnosed to be normal. Red light turns on when the output is saturated upscale or downscale.
[TRM] lamp	Green light turns on when the device measures temperature at the terminals. Red light turns on when the device is not able to measure temperature at the terminals; e.g. the CJC temperature sensor is not connected.
[PV] lamp	Green light turns on when the sensor input is in the specified range. Red light turns on when it is out of the range.

2.3.3. BARGRAPH & TREND GRAPH

Four bargraphs indicating PV in engineering unit, PV in % of the selected range, the terminal temperature and analog output in engineering unit are displayed [See Figure 3].

The graph scales for the PV in % and the terminal temperature can be modified while the PV and the analog output in engineering unit of which the scales are automatically determined and fixed according to the selected range. Please note that the terminal temperature may not be correctly displayed if CJM is not connected.

Click [Graph] button at the bottom of each bargraph to open a trend graph for the item as shown in Figure 4. Use [Start] and [Stop] buttons to start/stop recording data, and click [Close Trend Graph] to close the trend graph window.

PV Bargraph


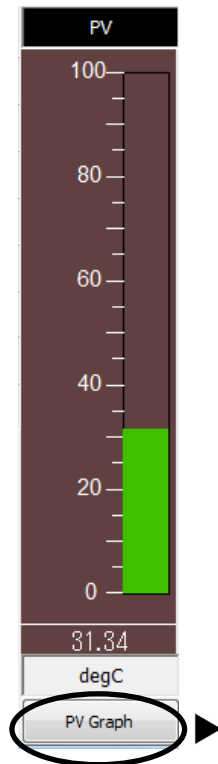


Figure 4. Trend Graph

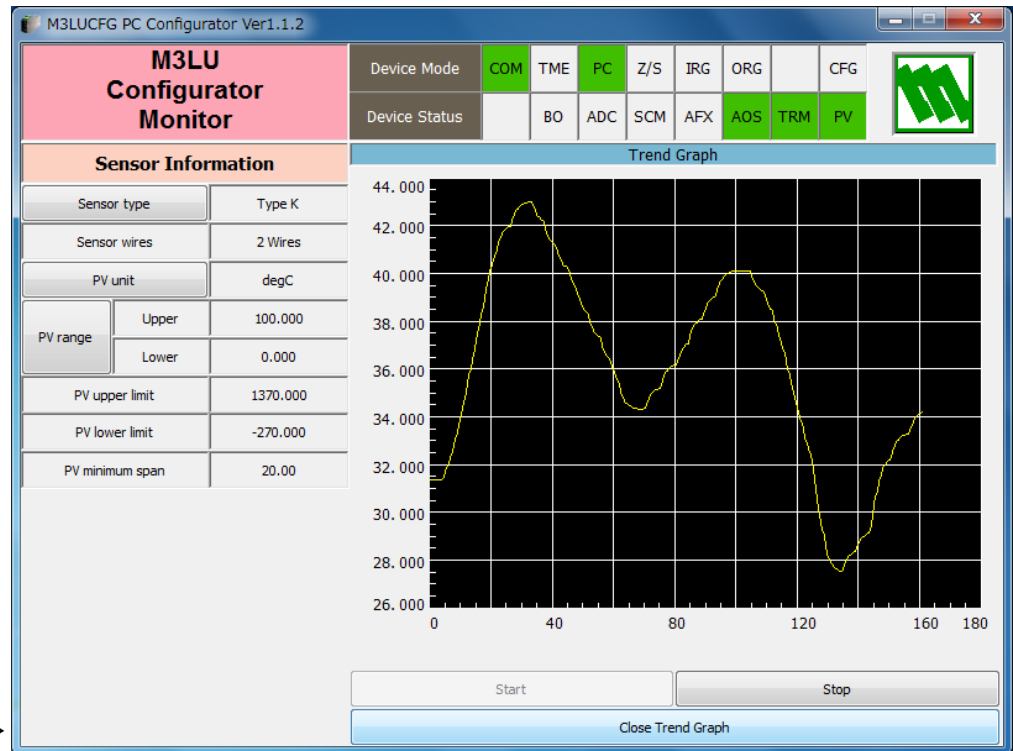

3. CONFIGURATION

3.1. INPUT CONFIGURATION


In Figure 3, the Sensor Information menu on the left shows basic configuration information of the connected device. When you need to change configurations, click the left button for the required parameter to modify its setting.

Sensor type	The input sensor type can be selected from the following 38 types.		
	DC	Thermocouple	RTD
	0 to 20 mA	Type B	Pt100
	-10 to 10 V	Type E	Pt200
	Millivolt	Type J	Pt300
	Potentiometer	Type K	Pt400
	POT 4000 ohms	Type N	Pt500
	POT 2500 ohms	Type R	Pt1000
	POT 1200 ohms	Type S	Pt50(JIS81)
	POT 600 ohms	Type T	JPt100(JIS89)
	POT 300 ohms	Type C	Ni100
	POT 150 ohms	Type U	Ni120
	Resistance	Type L	Cu10@25
	OHM Resistance	Type P	Ni508.4
	Type PR	NiFe604	
	Custom TC	Custom RTD	
	Click [Sensor type] button to choose the input sensor type and the number of sensor wires Once the sensor setting is done, default values are set in the input range.		
Sensor wires	Select the number of sensor wires when the sensor type is Resistance or Thermocouple. 2 Wires 3 Wires 4 Wires		
PV unit	Click [PV unit] button to select the engineering unit type. The selected unit type is applied to PV range, upper limit, lower limit, and minimum span values. The unit type can be changed only when the sensor type is Thermocouple or RTD.		
PV range (Upper / Lower)	Specifies input range for 0% and 100%. Click the left button opens a dialog box to change the setting. The input range can be also changed on One Step Calibration mode.		
PV upper limit	Shows the usable range information for the selected type of sensor.		
PV lower limit			
PV minimum span			

3.2. DETAILED INFORMATION

In Figure 3, click [Detailed Info] in Functions menu to the right opens the [Detailed Information] menu as shown in Figure 5.

Figure 5. Detailed Information

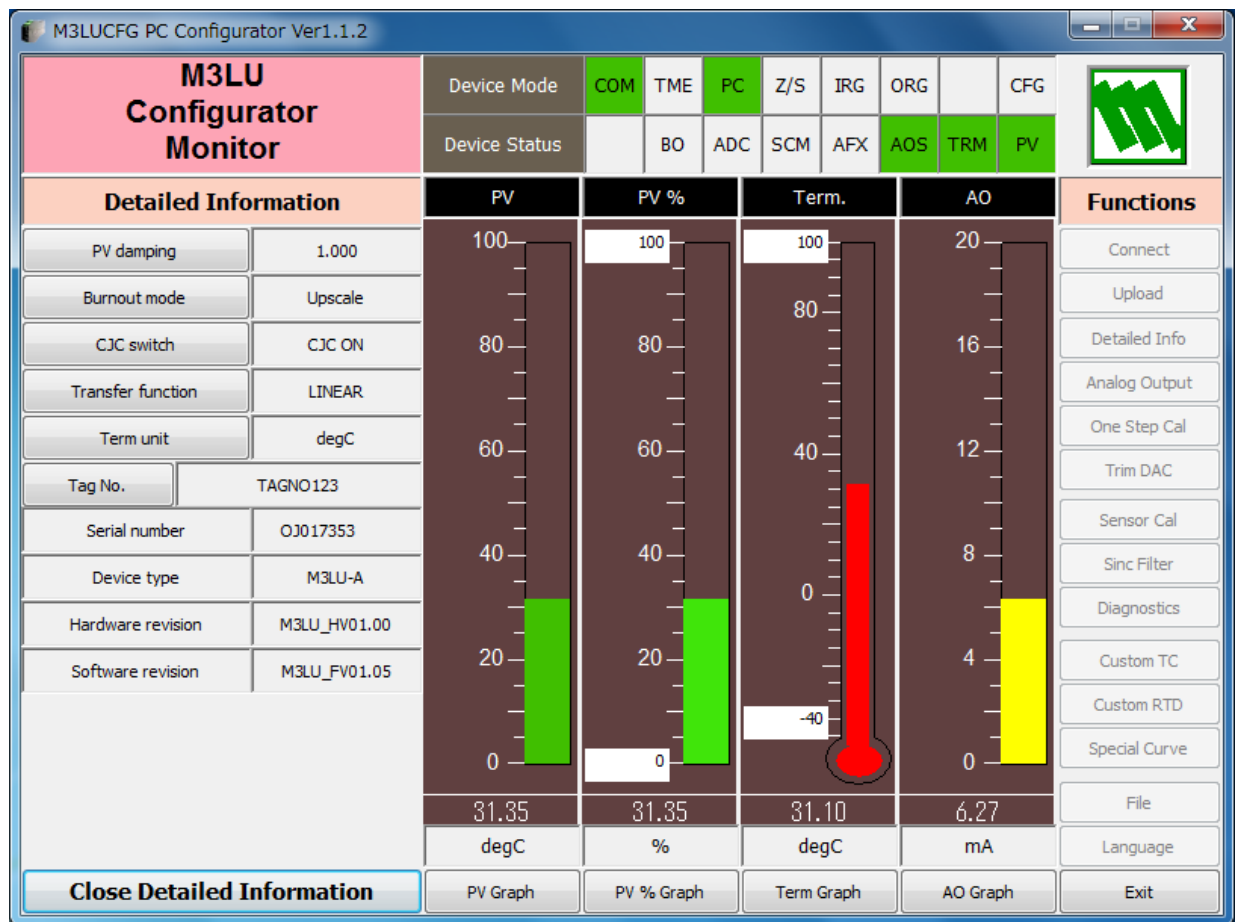


PV damping	Specifies the time constant for the primary input filter. Selectable range is from 0.5 sec. up to 30 sec. When you do not need a filtering, specify '0.'
Burnout mode	Specifies the burnout mode from among three choices. Upscale Downscale None Click [burnout mode] button to specify either the output should go upscale or downscale in case that a wire breakdown is detected.
CJC switch	Specifies the ON/OFF status of the CJC switch. CJC OFF CJC ON Click [CJC switch] button enables (ON) or disables (OFF) the cold junction compensation. When the sensor type is Thermocouple, the CJC switch is automatically enabled.
Transfer function	Enable/disable the Transfer function. Choose from among following 3 types. LINEAR SQRT SPECIAL_CURVE Click [Transfer function] button to specify either the output should be linear to the input signal or linearized to a custom curve data.

Term unit	<p>The engineering unit for the terminal temperature can be selected from among the following choices.</p> <p>degC degF degR Kelvin</p> <p>Click [Term unit] button to choose the unit type.</p>
Tag No.	You can enter a tag name using up to 16 alphanumerical characters.
Serial number	Automatically displayed.
Device type	
Hardware revision	
Software revision	
Close Detailed Information	Close the window.

3.3. ANALOG OUTPUT

In Figure 3, click [Analog Output] in Functions menu to the right opens the [Analog Output] menu as shown in Figure 6.

Figure 6. Analog Output

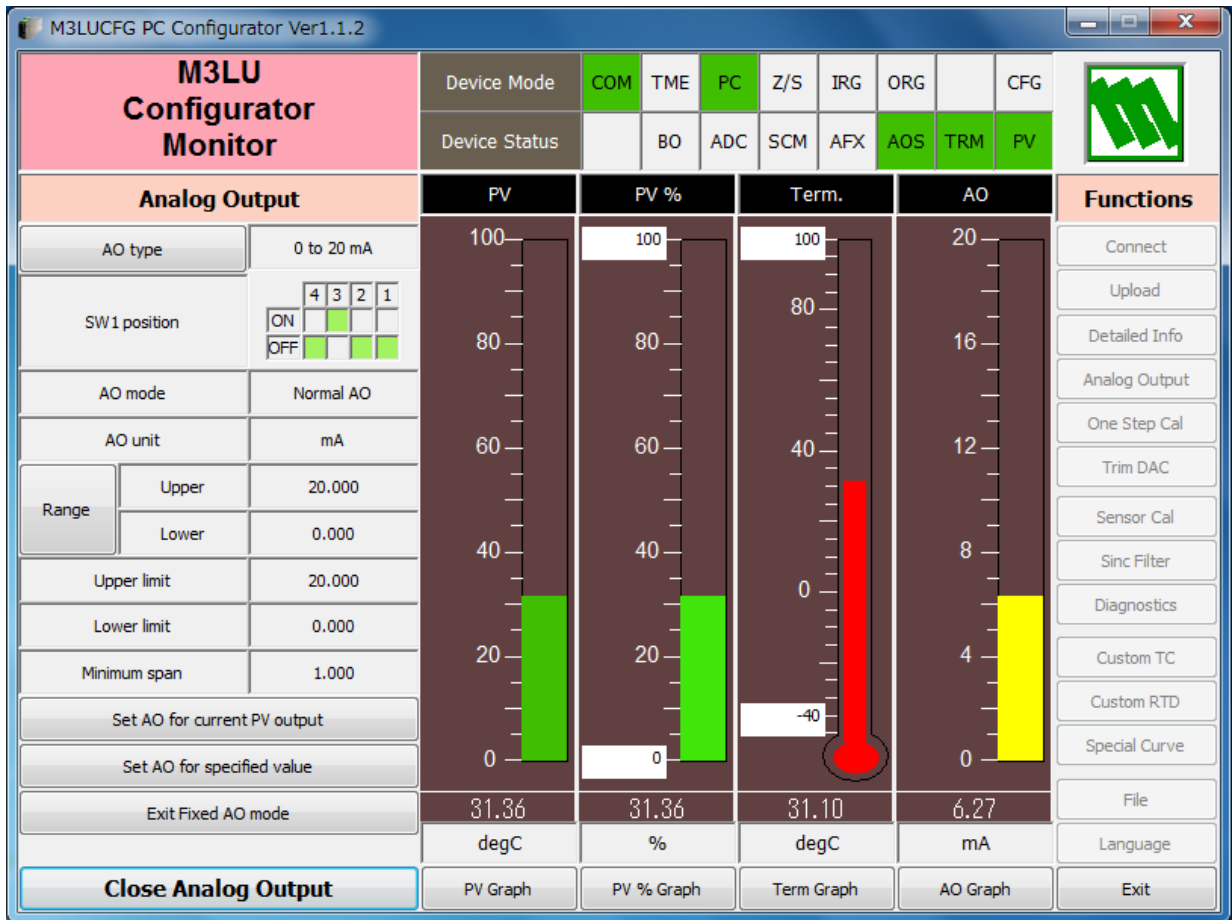

The Analog Output menu on the left shows the output type and ranges. When you need to change configurations, click the left button for the required item to modify the setting.


AO type	Specifies the Analog Output type from among three choices. 0 to 20 mA -2500 to +2500 mV -10 to +10 V Click [AO type] button to specify output type.
SW1 position	Shows DIP SW configuration (hardware setting) required for the selected output type. Confirm actual setting.
AO mode	Shows the output mode. 'Normal AO' is usually displayed.
AO unit	Shows engineering unit for the output signal.
Range (Upper / Lower)	Specifies the output range for 0% and 100%.
Upper limit	Show the usable range information for the selected output type.
Lower limit	
Minimum span	
Set AO for current PV output	The output signal is held at the current value.
Set AO for specified value	You can set a specific value to fix the output in order to perform an output loop simulation test.
Exit Fixed AO mode	Cancels the fixed output mode to return the device into normal output mode.
Close Analog Output	Close the window.

3.4. ADC CONVERSION RATE

Click [Sinc Filter] button to open the Sinc Filter window as shown in Figure 7.

ADC output rate can be selected among 10, 20, 40, 50 and 60 Hz. Choose 10 Hz for better accuracy; choose 50 or 60 Hz for better response time.

Figure 7. Sinc Filter

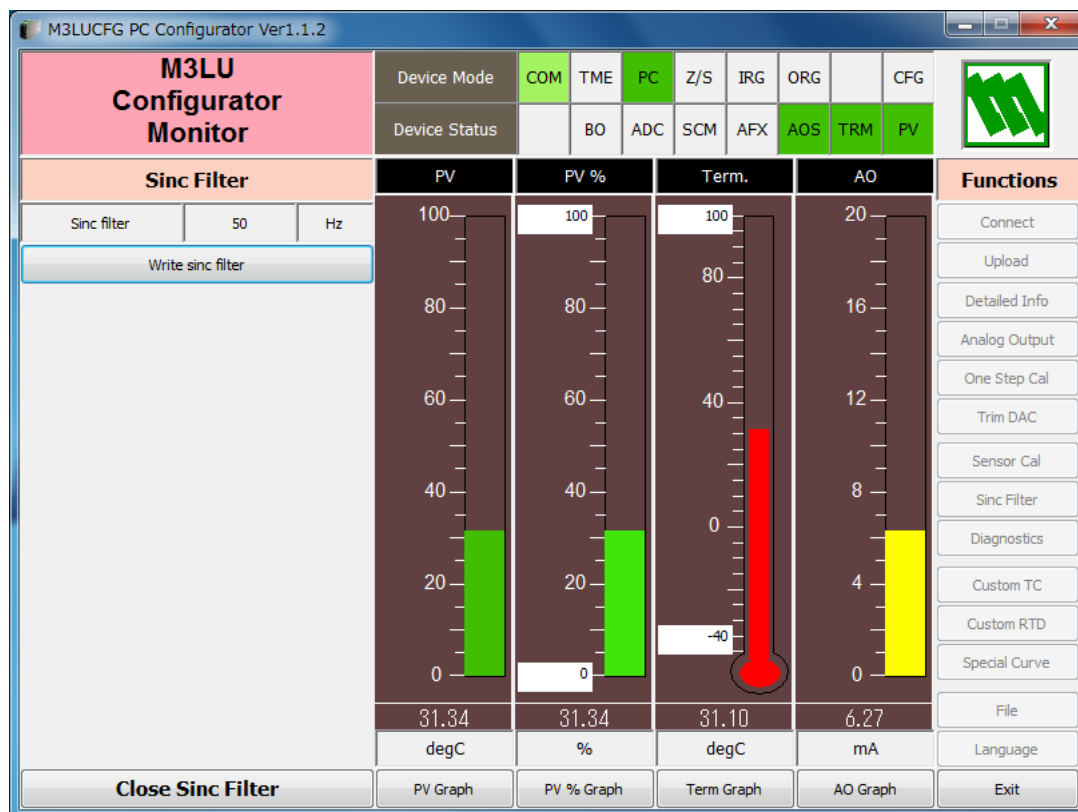


[Write sinc filter] Opens the frequency selection buttons. Choose one and click OK.

[Close Sinc Filter] Close the window.

4. ONE STEP CALIBRATION

In Figure 3, click [One Step Cal] on the right control panel opens the One Step Calibration menu as shown in Figure 8. The 'One Step Calibration' technique realizes automatic input and output ranging with a signal simulator connected to the module's input terminals.

Figure 8. One Step Calibration

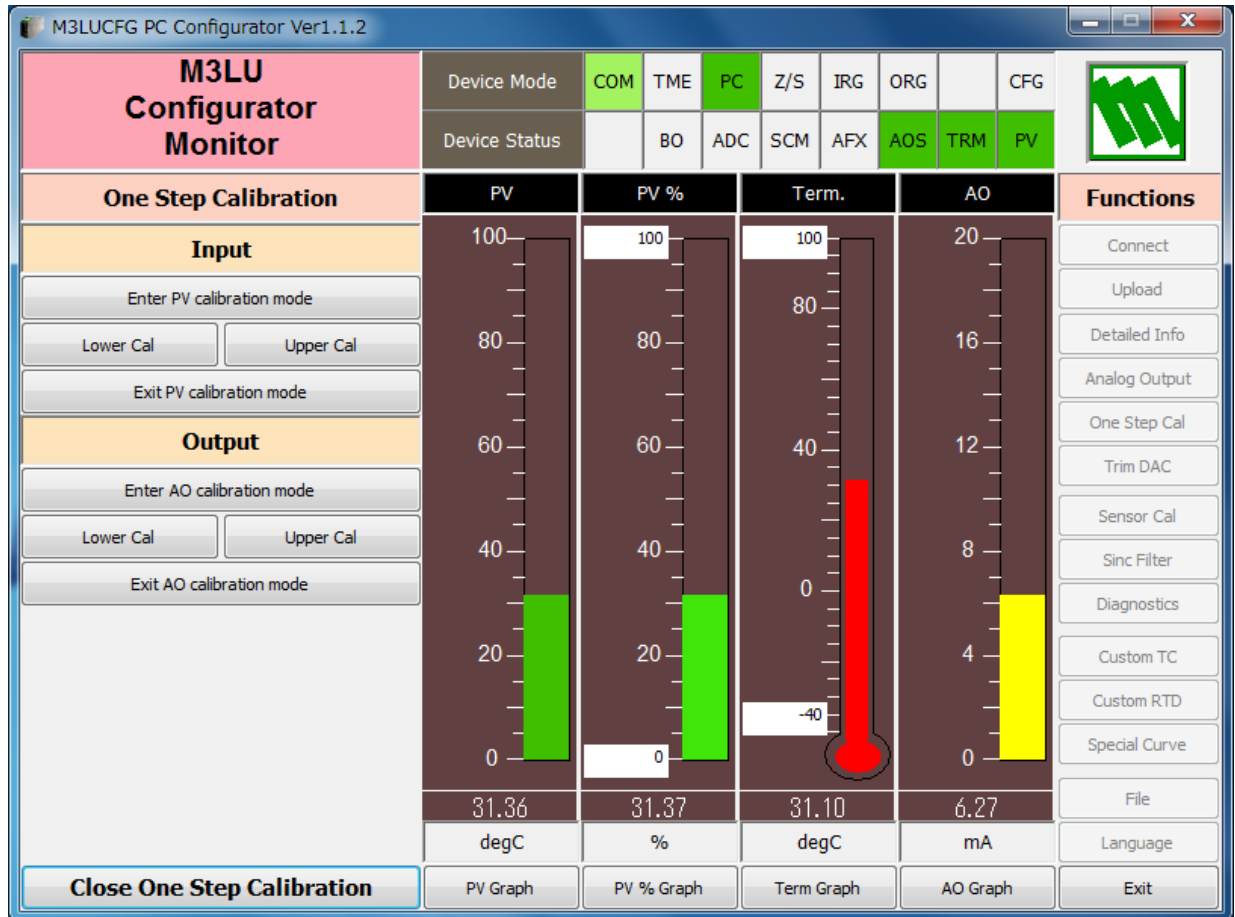

4.1. INPUT CALIBRATION MODE



- (1) Connect the M3LU to a simulator as described in the M3LU instruction manual.
- (2) Click [Enter PV calibration mode] in order to turn the module into the input calibration mode. The red [IRG] lamp in [Device Mode] panel at the top turns ON while the module is in this mode.



- (3) Apply desired 0% and 100% signal levels and click [Lower Cal] and [Upper Cal] buttons respectively so that the input range is automatically set.

Input: 100 mV (Lower Cal)

Input: 500 mV (Upper Cal)

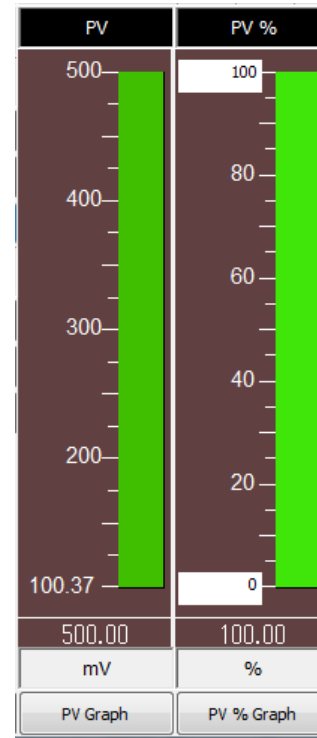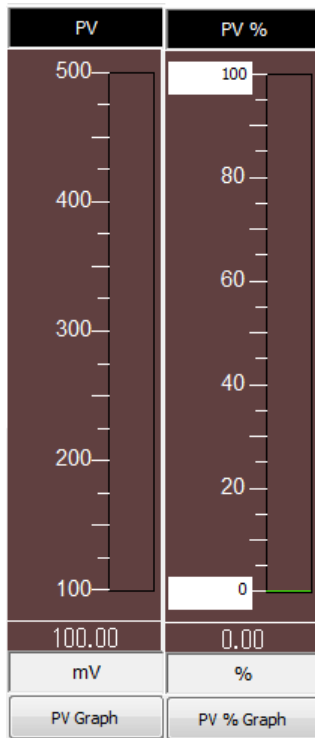

- (4) Click [Exit PV calibration mode] when the calibration is complete.


4.2. OUTPUT CALIBRATION MODE

(1) Click [Enter AO calibration mode] in order to turn the module into the output calibration mode. The red [ORG] lamp in [Device Mode] panel at the top turns ON while the module is in this mode.




(2) Increase or decrease the simulated input until the output multimeter shows desired 0% and 100% signal levels and click [Lower Cal] and [Upper Cal] buttons respectively so that the output range is automatically set.

Apply the input so that output become 0%

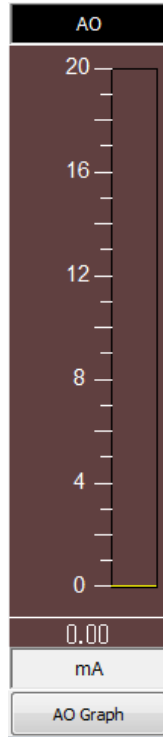

Apply the input so that output become 100%

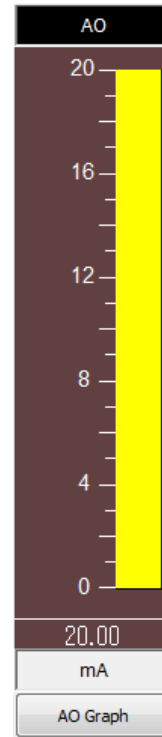

(3) Click [Exit AO calibration mode] when the calibration is complete.


Click [Close One Step Calibration] to close the window.

5. INPUT / OUTPUT CALIBRATION

5.1. DAC TRIMMING

Click [Trim DAC] button to open the Trim DAC window as shown in Figure 9.

Figure 9. Trim DAC (e.g. Upper Range Trim Mode)

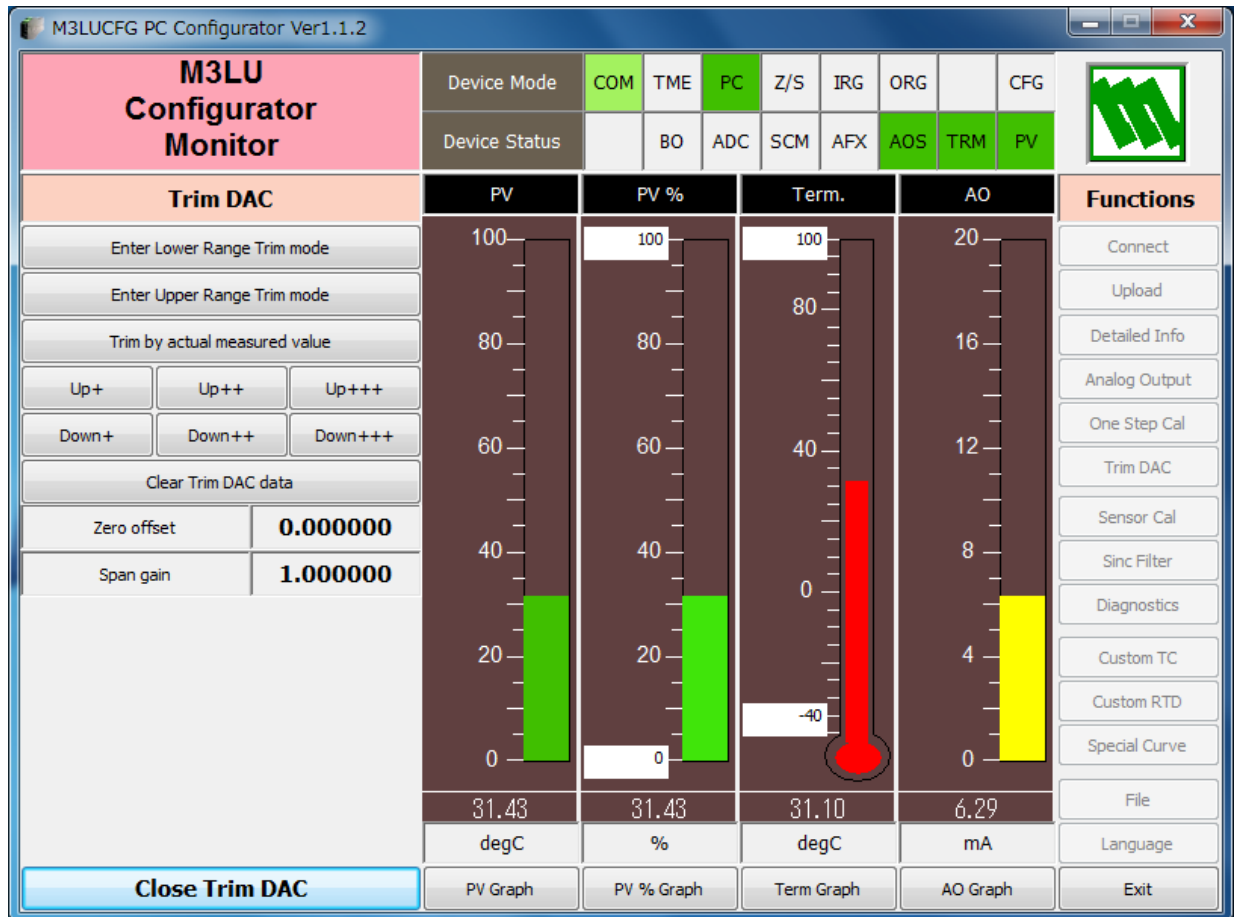

5.1.1. LOWER RANGE DAC TRIMMING

- (1) Click [Enter Lower Range Trim mode]. The device outputs a fixed lower range signal level.
- (2) Measure the actual output signal at the receiving instrument to which the device output should be matched.
- (3) Click [Trim by actual measured value] to set the measured value.
- (4) Repeat setting [Trim by actual measured value] until the measured output shows the desired level. Alternately, use [Up] or [Down] buttons. [+], [++] and [+++] have different increments. Deviation from the default value is shown in [Zero offset]. Lower range value is adjustable within $\pm 15\%$.

5.1.2. UPPER RANGE DAC TRIMMING

- (1) Click [Enter Upper Range Trim Mode]. The device outputs a fixed upper range signal level.
- (2) Measure the actual output signal at the receiving instrument to which the device output should be matched.
- (3) Click [Trim by actual measured value] to set the measured value.
- (4) Repeat setting [Trim by actual measured value] until the measured output shows the desired level. Alternately, use [Up] or [Down] buttons. [+], [++] and [+++] have different increments. Deviation from the default value is shown in [Span gain]. Upper range value is adjustable within $\pm 15\%$.

5.1.3. RESETTING TO THE DEFAULT

Click [Clear Trim DAC data] to return the device to the factory default trimming values. Default values for Zero offset and Span gain are 0.0 and 1.0, respectively.

Click [Close Trim DAC] to close the window.


5.2. SENSOR CALIBRATION

The input sensor can be calibrated with Zero and Span: Zero is represented as offset at the calibration point, while the Span is represented as gain against the zero point. The gain must be set from 0.1 to 10.0.

Calibration points can be specified to any point within the measuring range. The DC current/voltage and thermocouple inputs are calibrated against the measured current/voltage; while the RTD and resistance input are against the measured resistance. Errors caused by extension wire resistance for 2-wire RTDs and by imbalance in that for 3-wire RTDs can be calibrated by the Zero adjustment.

Click [Sensor Cal] button to open the Sensor Calibration window as shown in Figure 10.

Figure 10. Sensor Calibration

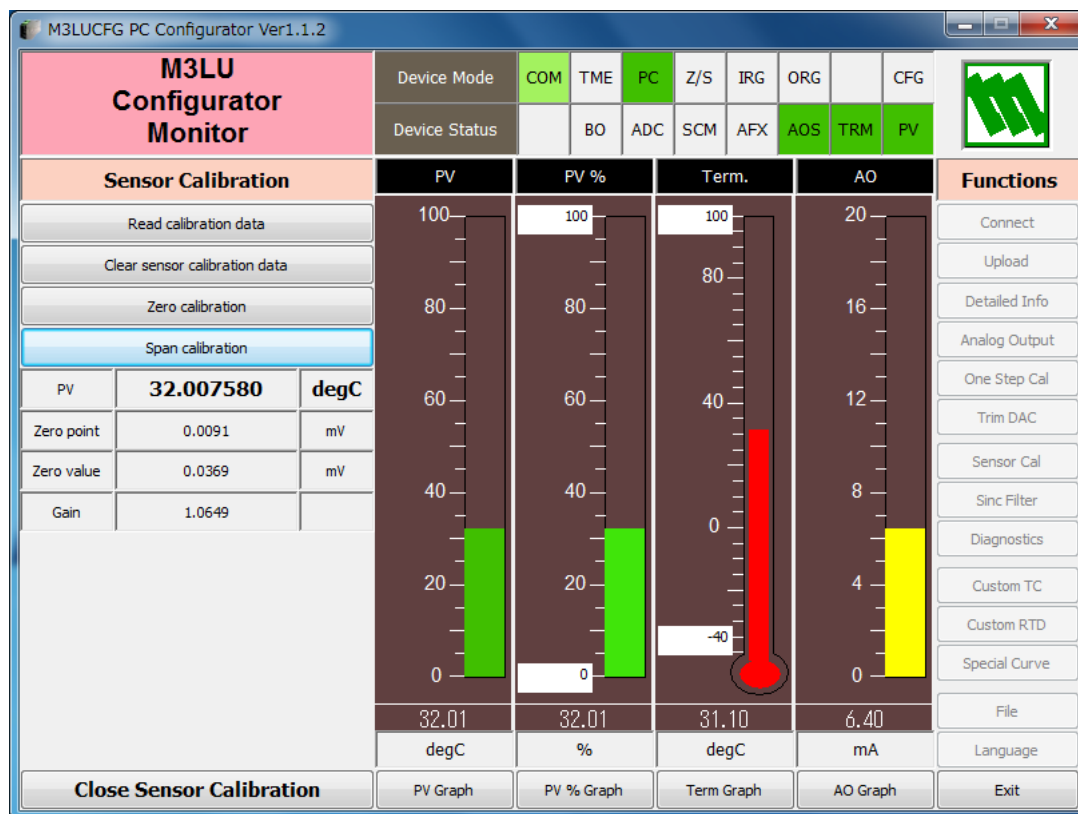

The present measured value is indicated in the middle. Refer to this value when calibrating the sensor. It takes several seconds for the calibration result affects the measured value on the display.

Apply zero calibration point input signal and click [Zero calibration] to open the field where you can enter a target value. The result is shown in the PV display field. Data before calibration is shown in the Zero point field, while that after calibration is shown in the Zero value field.

Apply span calibration point input signal and click [Span calibration] to open the field where you can enter a target value. The result is shown in the PV display field. Span point gain against the zero point is shown in the Gain field. [Read calibration data] calls up and display the present calibrated values in these fields.

Click [Clear sensor calibration data] to return the device to the factory default status.

Factory Default

DC and thermocouple inputs	Zero point = Zero value = 0 mV/0 mA, Gain = 1.0
RTD input	Zero point = Zero value = Resistance (Ω) at 0°C, Gain = 1.0
Resistance input	Zero point = Zero value = 0 Ω , Gain = 1.0
Potentiometer input	Zero point = Zero value = 0%, Gain = 1.0

When the sensor type is changed, the calibration data are reset to these factory default values.

Click [Close Sensor Calibration] to close the window.

6. OFFLINE CONFIGURATION AND READ / WRITE FILES

6.1. CUSTOM TC

The M3LU supports the user-specific thermocouple table function. In order to use a user-specific table, the data in text format must be defined and registered. The procedure to use user-specific TC is as follows.

1. Create a user-specific table as following steps.
2. Click [Custom TC] button to open the Custom TC.
3. Click [Read table from file] button to read a characteristics data from a file stored in the PC. When uploaded, the file contents summary is indicated under Custom TC Table Contents. Characteristic data longer than 1000 points are ignored.
4. Click [Display custom TC graph] button to show characteristics data in a graph.
5. Click [Write table to device] button to download currently displayed characteristics data to the M3LU.
6. When downloading is successfully complete, Status under Custom TC Table Contents shows 'Configured.' Then the option 'TC Spec (Custom TC)' becomes available to choose. If 'TC Spec' has been already selected before this setting is done, you can not download a particular data file.
7. Click [Read table from device] button to upload characteristics table registered in the M3LU. If there is no file registered, Status under Custom TC Table Contents shows 'Non configured.'
8. Click [Close Custom TC] button to close the window.

6.1.1. USER-SPECIFIC TC TABLE

User-specific TC data is defined in the format of texts. The file format is as following.

Define the minimum temperature value in Celsius (integer) at Minimum TC Temperature.

Specify the Temperature Step used in the table, from 1°C to 50°C (integer).

Describe characteristics data within { }. Data must be entered in mV. Up to 1000 points can be specified.


```

/*****
/* Custom TC Table Definition
/* Ti = f(Xi) ( 0 <= i < Size )
/*   Temperature Step (1 to 50 degC)
/*   -100 <= X(i)<= 1000 mV
/*   X(i) < X(i+1)
/*   2<= Size <= 1000
/*****
Minimum TC Temperature = 0      <-- Minimum temperature T0 (°C)
Step = 10                      <-- Temperature step (°C)
{
10.0000                        <-- Voltage value for T0 (mV)
:
20.0000                        <-- Voltage for Tmax (mV)
}
```

6.1.2. CUSTOM TC WINDOW


Click [Custom TC] button to open the Custom TC as shown in Figure 11.

Figure 11. Custom TC

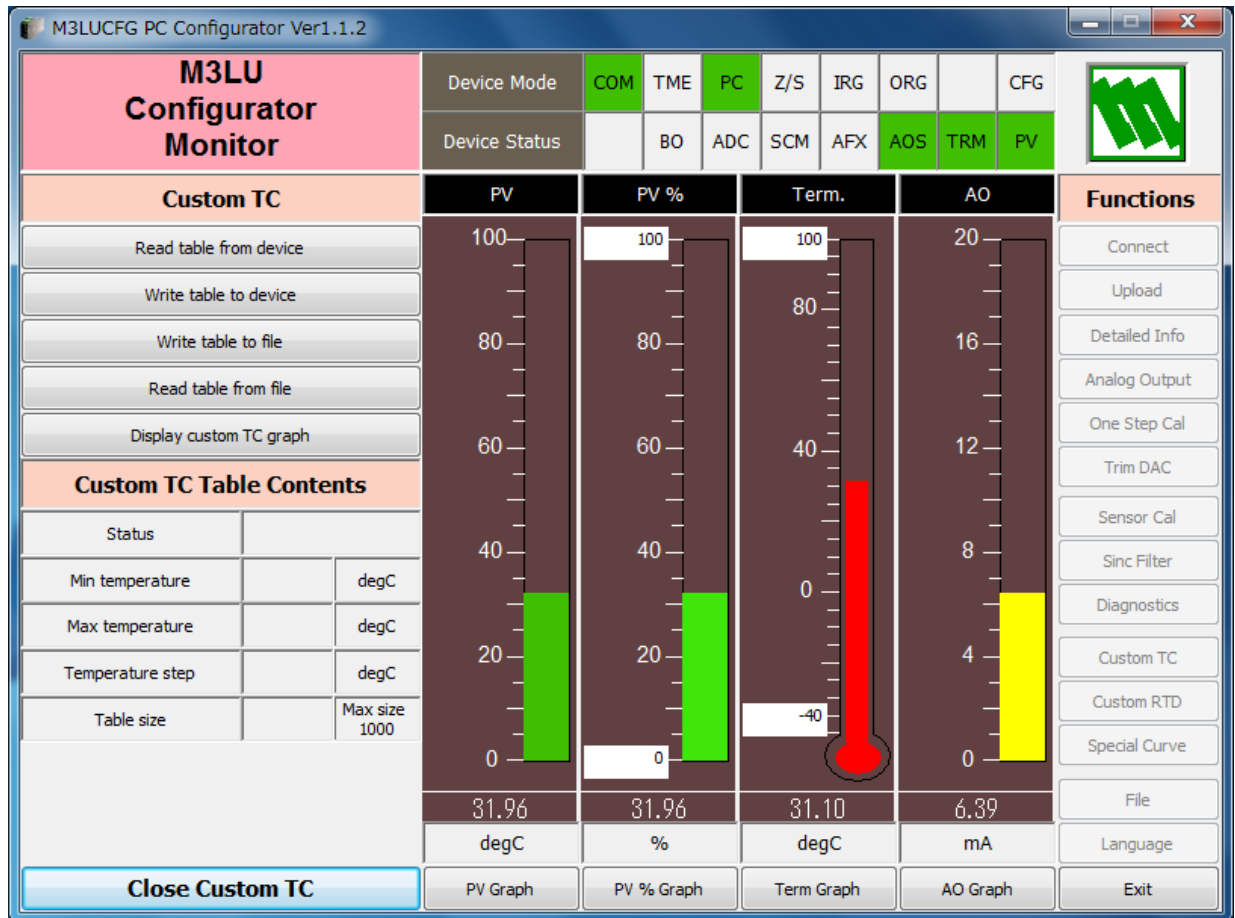

Read table from device	The program uploads characteristics table registered in the M3LU. If there is no file registered, Status under Custom TC Table Contents shows 'Non configured.'	
Write table to device	The program downloads currently displayed characteristics to the M3LU. When downloading is successfully complete, Status under Custom TC Table Contents shows 'Configured.'	
Write table to file	The program saves currently displayed characteristics data to a file. After reading the data from M3LU to the table in the PC with [Read table from device], save the data.	
Read table from file	The program uploads a file stored in the PC. When uploaded, the file contents summary is indicated under Custom TC Table Contents.	
Display custom TC graph	Characteristics data can be shown in a graph. (figure 12)	
Custom TC Table Contents	Show the summary of Custom TC Table	
	Status	Show the status of Custom TC Table.
	Min temperature	Minimum temperature in degC
	Max temperature	Maximum temperature in degC
	Temperature step	Temperature step in degC
Table size	Defined number of point	
Close Custom TC	Close the window.	

Figure 12. Custom TC graph

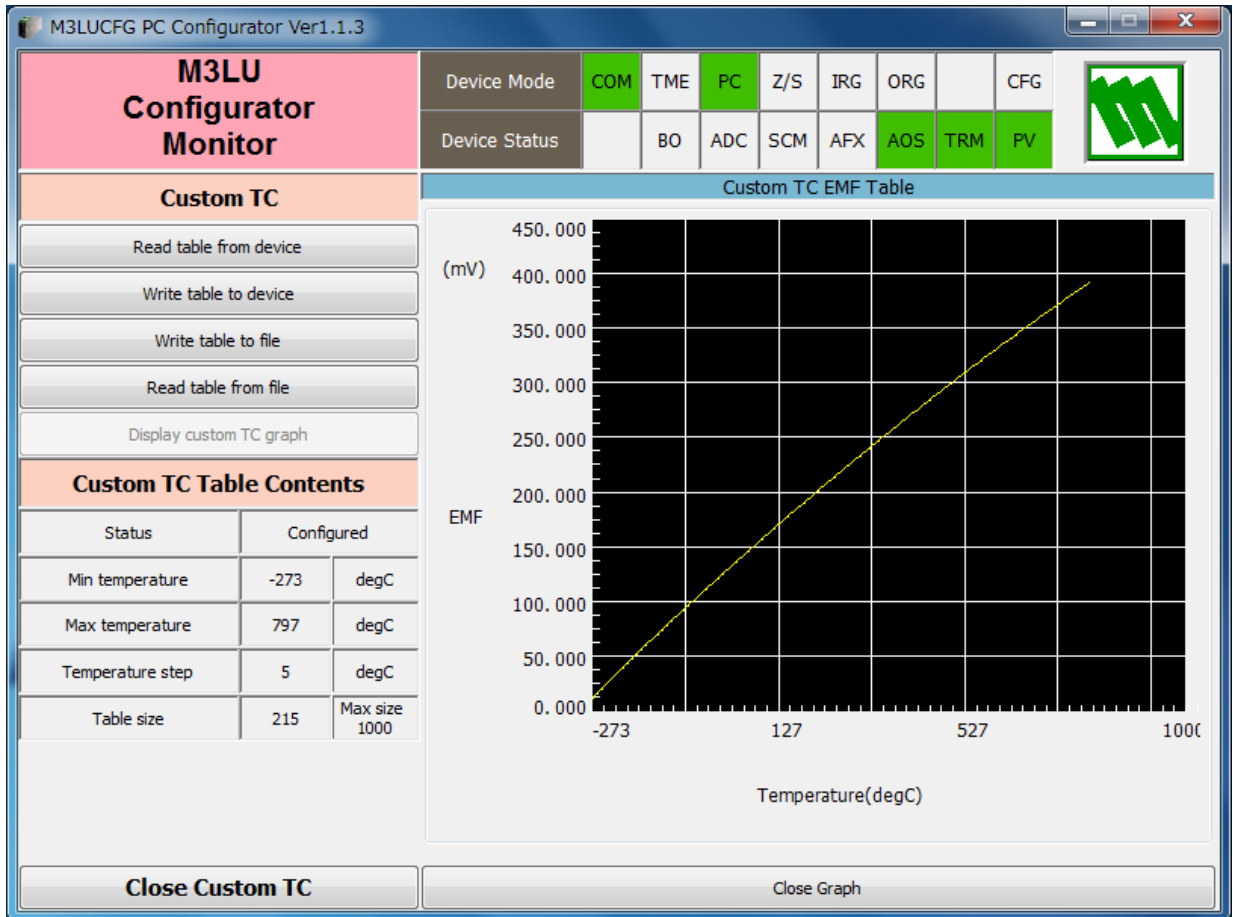

6.2. CUSTOM RTD

The M3LU supports the user-specific RTD table function. In order to use a user-specific table, the data in text format must be defined and registered. The procedure to use user-specific RTD is as follows.

1. Create a user-specific table as following steps.
2. Click [Custom RTD] button to open the Custom RTD.
3. Click [Read table from file] button to read a characteristics data from a file stored in the PC. When uploaded, the file contents summary is indicated under Custom RTD Table Contents. Characteristic data longer than 500 points are ignored.
4. Click [Display custom RTD graph] button to show characteristics data in a graph.
5. Click [Write table to device] button to download currently displayed characteristics data to the M3LU.
6. When downloading is successfully complete, Status under Custom RTD Table Contents shows 'Configured.' Then the option 'RTD Spec (Custom RTD)' becomes available to choose. If 'RTD Spec' has been already selected before this setting is done, you can not download a particular data file.
7. Click [Read table from device] button to upload characteristics table registered in the M3LU. If there is no file registered, Status under Custom RTD Table Contents shows 'Non configured.'
8. Click [Close Custom RTD] button to close the window.

6.2.1. USER-SPECIFIC RTD TABLE

User-specific RTD data is defined in the format of texts. The file format is as following.

Define the minimum temperature value in Celsius (integer) at Minimum RTD Temperature.

Specify the Temperature Step used in the table, from 1°C to 50°C (integer).


Describe characteristics data within { }. Data must be entered in ohms. Up to 500 points can be specified.

```
/* *****  
/* Custom RTD Table Definition  
/* Ti=f(Xi) (0<=i<Size)  
/* Temperature Step (1 to 50 degC)  
/* 0<=Xi<4000 Ohm  
/* Xi<Xi+1  
/* 2<=Size<=500  
/* *****  
Minimum RTD Temperature=0 <- Minimum temperature T0 (°C)  
Step=10 <- Temperature step (°C)  
{  
100.000000 <- Resistance value for T0 (Ohm)  
:  
200.000000 <- Resistance for Tmax (Ohm)  
}
```

6.2.2. CUSTOM RTD WINDOW


Click [Custom RTD] button to open the Custom RTD as shown in Figure 13.

Figure 13. Custom RTD

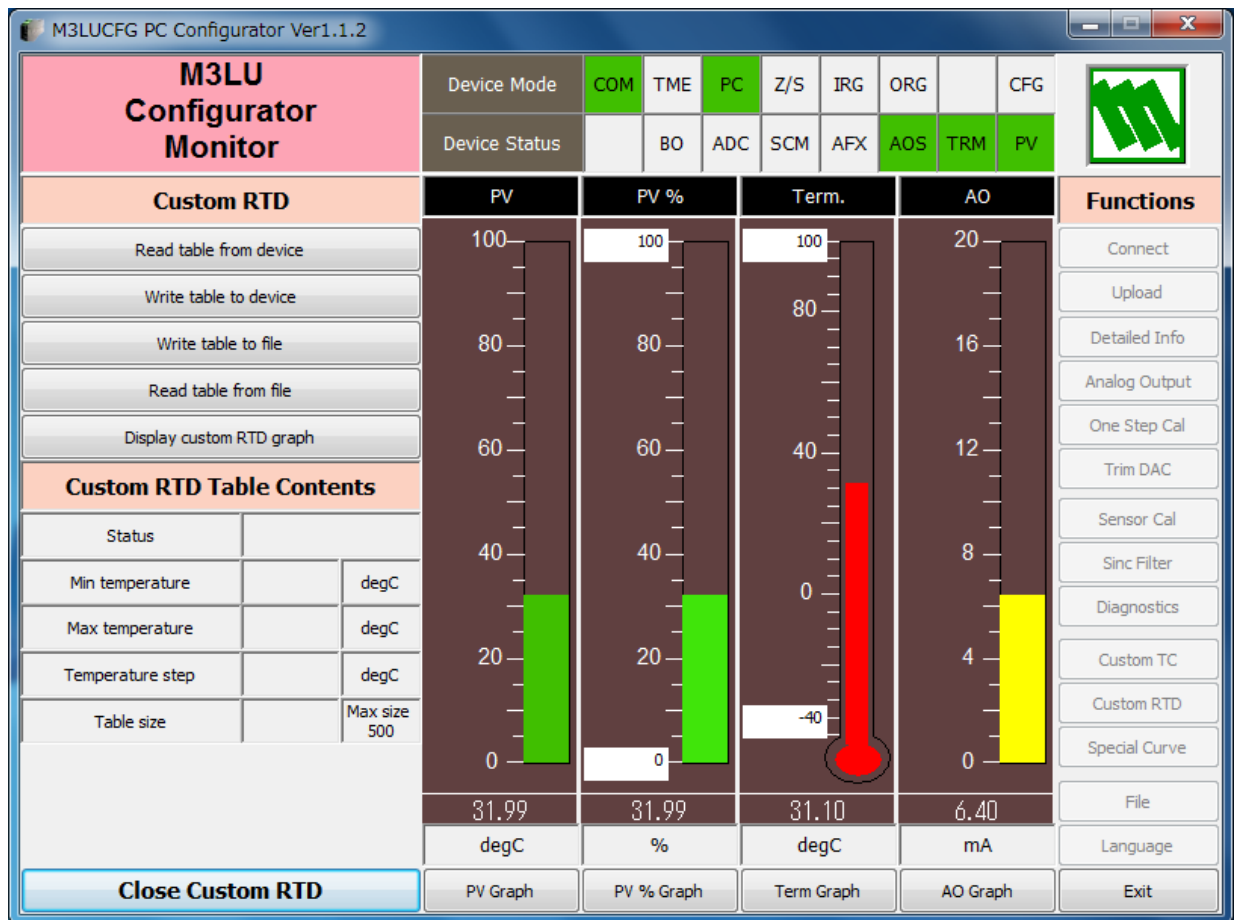

Read table from device	The program uploads characteristics table registered in the M3LU. If there is no file registered, Status under Custom RTD Table Contents shows 'Non configured.'	
Write table to device	The program downloads currently displayed characteristics to the M3LU. When downloading is successfully complete, Status under Custom RTD Table Contents shows 'Configured.'	
Write table to file	The program saves currently displayed characteristics data to a file. After reading the data from M3LU to the table in the PC with [Read table from device], save the data.	
Read table from file	The program uploads a file stored in the PC. When uploaded, the file contents summary is indicated under Custom RTD Table Contents.	
Display custom RTD graph	Characteristics data can be shown in a graph. (figure 14)	
Custom RTD Table Contents	Show the summary of Custom RTD Table	
	Status	Show the status of Custom RTD Table.
	Min temperature	Minimum temperature in degC
	Max temperature	Maximum temperature in degC
	Temperature step	Temperature step in degC
Table size	Defined number of point	
Close Custom RTD	Close the window.	

Figure 14. Custom RTD graph

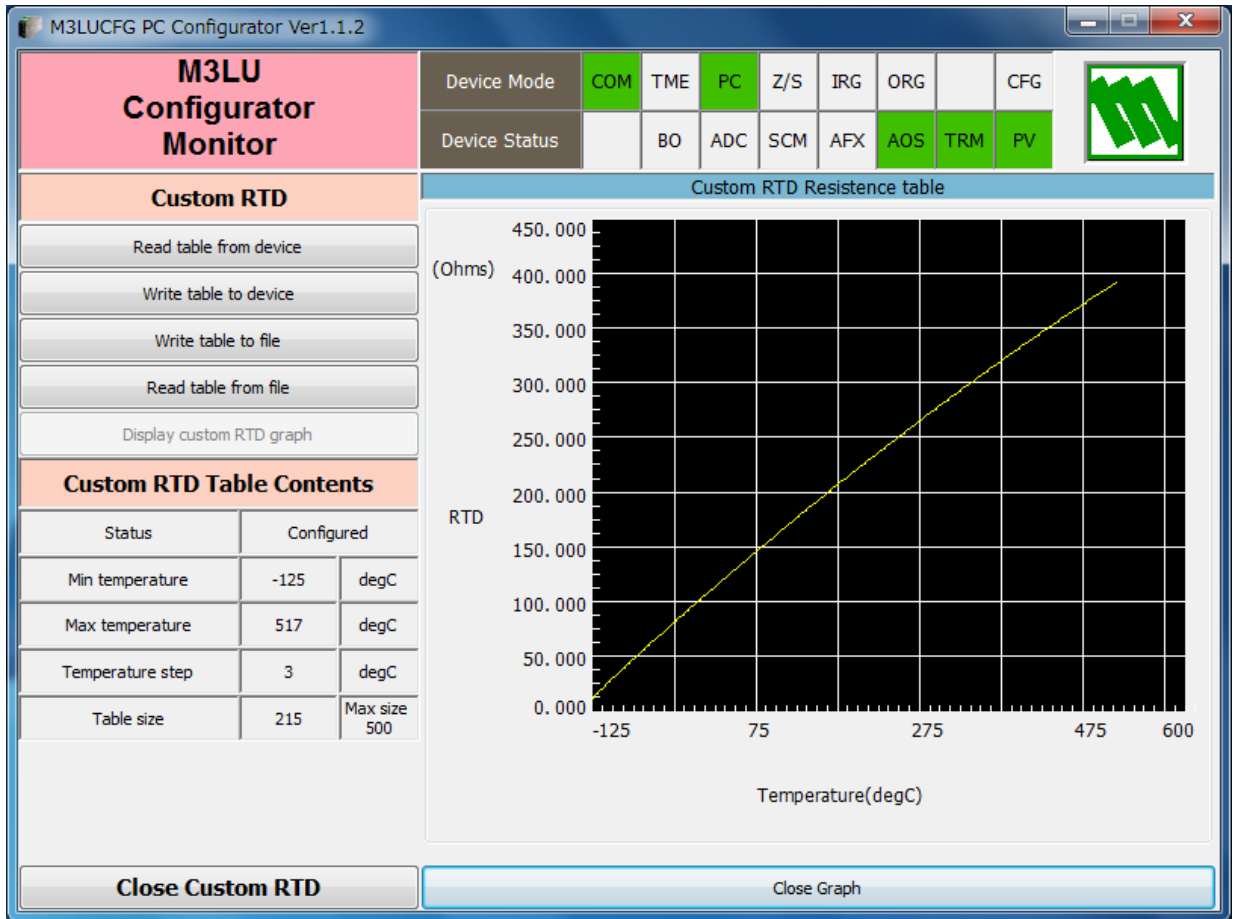

6.3. LINEARIZATION TABLE

The M3LU supports the user-specific linearization table function (Special_Curve). In order to use the Special_Curve, the data in text format must be defined and registered. Specify "SPECIAL_CURVE" of [Transfer function] in the Detailed Information window, and then the user-specific transfer function can be used. The procedure to use user-specific transfer function is as follows.

1. Create a user-specific linearization table as follows.
2. Click [Transfer function] button on the Detailed Information menu and select "LINEAR." (A new transfer function cannot be written when "SPECIAL_CURVE" is selected.)
3. Click [Special Curve] button to open the Special Curve window.
4. Click [Read table from file] button to read a created linearization table. Basic information is shown in the Special Curve Table Contents.
5. Click [Display Special Curve graph] button to show characteristics data in a graph.
6. Click [Write table to device] button to download currently displayed characteristics data to the M3LU.
7. Confirm that status under Special Curve Table Contents shows 'Configured. This means a SPECIAL_CURVE is registered in the device. If the status under Special Curve Table Contents does not show 'Configured, [Transfer function] can not be set to SPECIAL_CURVE.
8. Click [Transfer function] button on the Detailed Information menu and select "SPECIAL_CURVE" to enable the new transfer function.

6.3.1. LINEARIZATION TABLE SETTING

For the user-specific linearization table, the data in text format must be defined and registered. The file format is as following.


Describe the characteristics data within { }. Sets of X and Y values must be entered in %. Up to 128 points can be specified.

```
/* *****  
/* Linearization Table( Special Curve ) Definition  
/* Yi = f(Xi) ( 0 <= i < Size )  
/* -15<= X, Y <= 115 %  
/* Xi < Xi+1  
/* 2<= Size <= 128  
/* *****  
{  
0.000000, 0.000000 <-- The minimum X and Y values  
:  
100.000000, 100.000000 <-- The maximum X and Y values  
}
```

6.3.2. SPECIAL CURVE


Click [Special Curve] button to open the Special Curve as shown in Figure 15.

Figure 15. Special Curve

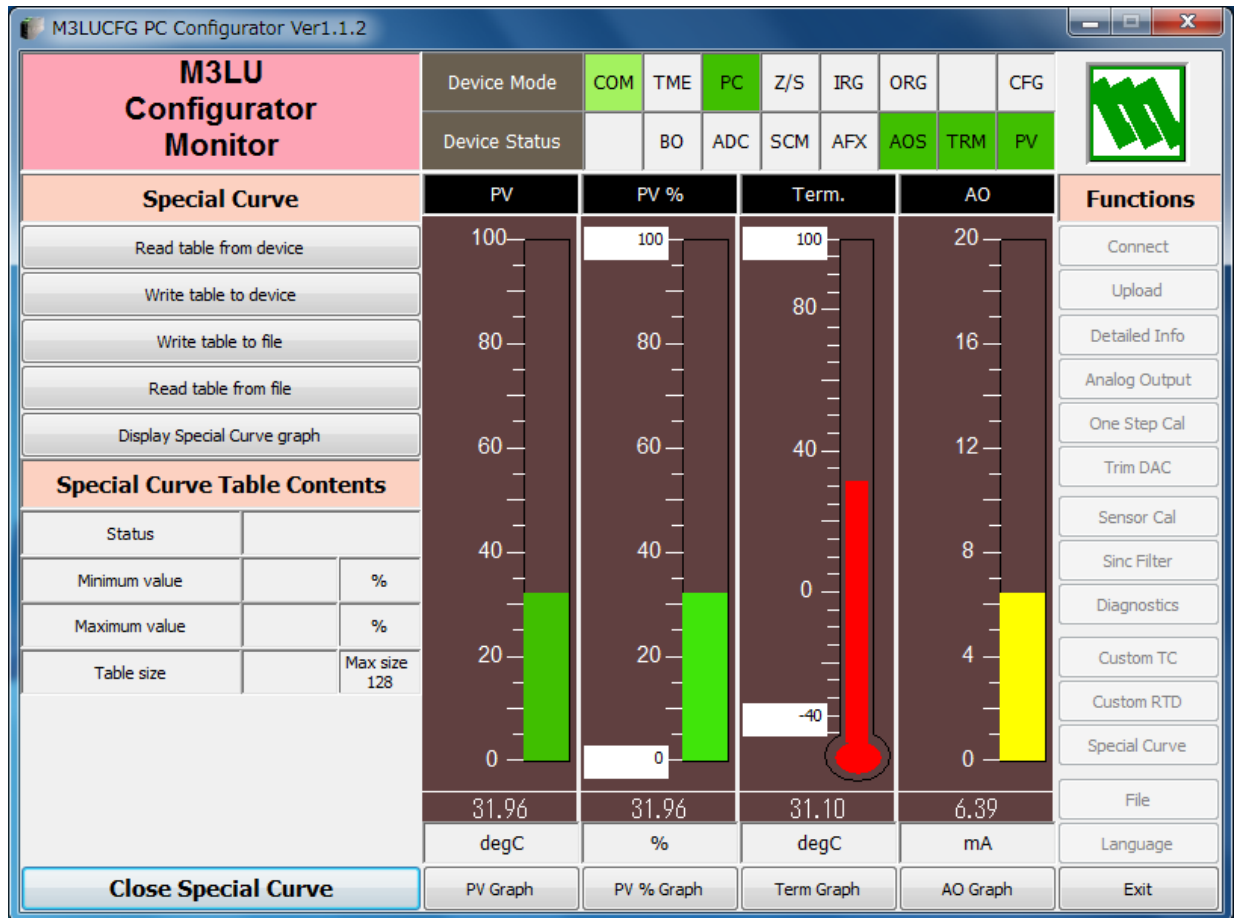

Read table from device	The program uploads characteristics table registered in the M3LU. If there is no file registered, Status under Special Curve Table Contents shows 'Non configured.'	
Write table to device	The program downloads currently displayed characteristics to the M3LU. When downloading is successfully complete, Status under Special Curve Table Contents shows 'Configured.'	
Write table to file	The program saves currently displayed characteristics data to a file.	
Read table from file	The program uploads a file stored in the PC. When uploaded, the file contents summary is indicated under Special Curve Table Contents.	
Display Special Curve graph	Characteristics data can be shown in a graph. (figure 16)	
Special Curve Table Contents	Show the summary of Special Curve Table	
	Status	Show the status of Special Curve Table.
	Minimum value	Minimum input (x) in %
	Maximum value	Maximum input (x) in %
	Table size	Defined number of point
Close Special Curve	Close the window.	

Figure 16. Special Curve graph

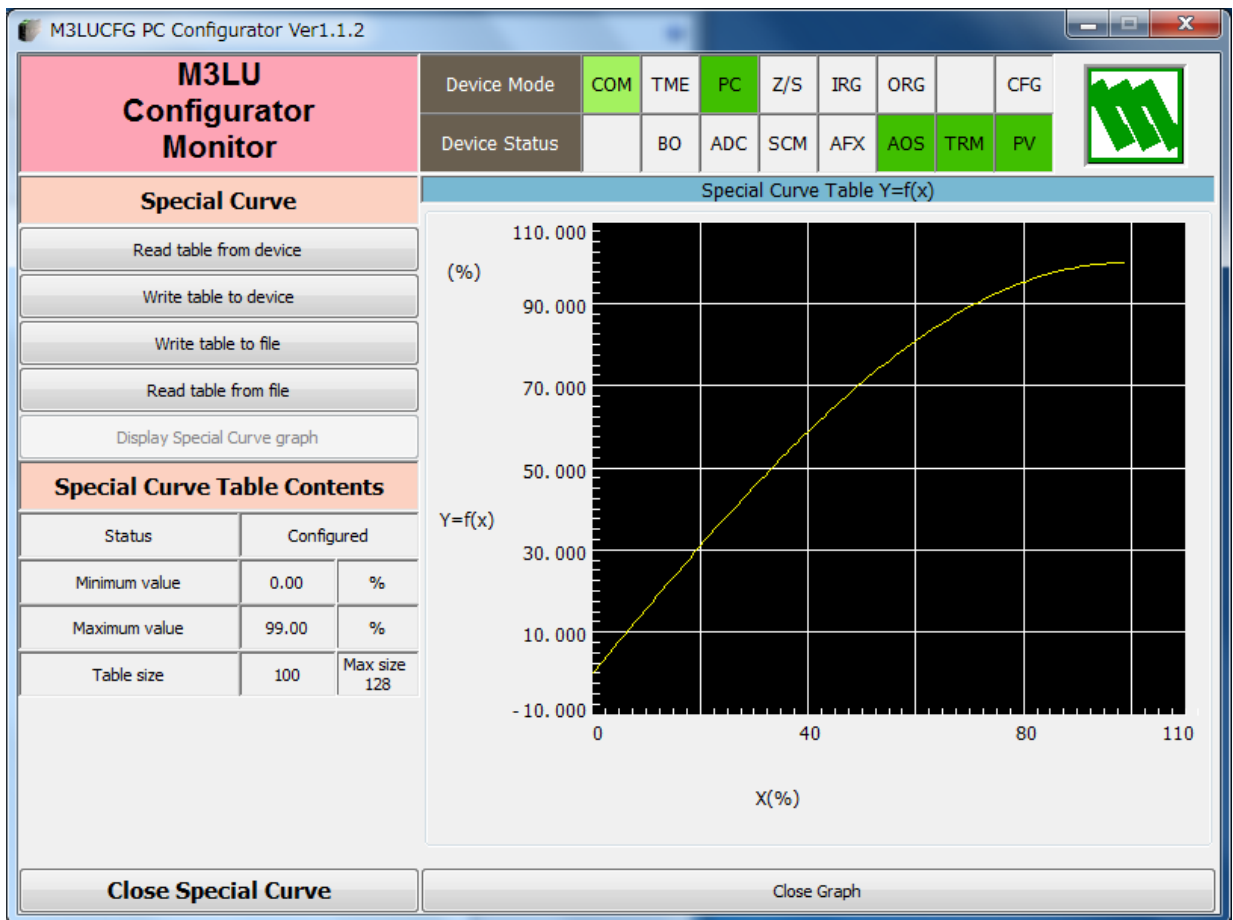

6.4. FILE MANAGEMENT

The M3LU's configurations can be saved in a file and then read out to be downloaded to multiple modules.

Click [File] button to open the File Management window as shown in Figure 17.

While this window is active, the device connection is severed, therefore the device can be connected and disconnected freely except during Upload or Download operations.

The window is divided in two sections: 'File Configuration' and 'Device Configuration.' 'File Configuration' shows data transfer (Read or Write) between the PC Configurator and the PC, while 'Device Configuration' shows data transfer (Upload or Download) between the configurator and the device.

Click [Exit] to complete the file management operations. The device will remain disconnected and must be 'Connected' to start monitoring.

NOTE

- (1) The selected range values are not verified in this view. Please make sure to set them according to the M3LU specifications.
- (2) Custom TC table data, Custom RTD table data and Special Curve Table data are not handled in this window.
- (3) With the Option /B version, [Download] button is invalid. However, it is possible to upload data and save it in a configuration file, or to compare it with other configurations.
- (4) A comment can be entered in 'Description' in the File Configuration section, which is not written in the Device Configuration section. When a setting is uploaded from device, the relevant field in the Device Configuration section shows the device's serial number.

Figure 17. File

Properties	File Configuration				Device Configuration			
Description	CHG		<	>				CHG
Tag No.	CHG		<	>				CHG
Sensor type	CHG							CHG
Sensor wires			<	>				
PV unit	CHG							CHG
PV upper range	CHG			<	>			CHG
PV lower range								
PV damping	CHG		Sec	<	>		Sec	CHG
Transfer function	CHG			<	>			CHG
Burnout mode	CHG			<	>			CHG
CJC switch	CHG			<	>			CHG
Term unit	CHG			<	>			CHG
AO type	CHG			<	>			CHG
AO upper range								
AO lower range	CHG			<	>			CHG

6.4.1. MODIFYING PARAMETERS

Click [CHG] button at the left of each field to modify the parameter. Fields in which the parameter has been changed will be highlighted in light yellow background color. [CHG] buttons placed across multiple fields indicate that these parameters can be modified in single sequence.

When one parameter has been changed, related fields may be also affected. For example, when 'Sensor type' is modified, 'PV range' may be automatically changed.

Parameters can be copied between 'File Configuration' and 'Device Configuration' using [<] and [>] buttons. Copied fields will be highlighted in light yellow background color.

Using [All Copy <<] or [All Copy >>] buttons enables transferring all parameters between the sections. Copied fields will be highlighted in light yellow background color.

Figure 18. Parameters Modified

M3LUCFG PC Configurator Ver1.1.2											
Exit		Page		Read File		Write File		Upload		Download	
		1		Compare		All Copy <<		>> All Copy		Compare	
Properties			File Configuration				Device Configuration				
Description		CHG	OJ017353				<	>	OJ017353		CHG
Tag No.		CHG	TAG TEST1				<	>	TAGNO123		CHG
Sensor type		CHG	Type K						Pt100		CHG
Sensor wires			2 Wires				<	>	3 Wires		CHG
PV unit		CHG	degC						degC		CHG
PV upper range		CHG	500.000	degC		<	>	100.000	degC	CHG	
PV lower range		CHG	0.000	degC				0.000	degC	CHG	
PV damping		CHG	1.000	Sec		<	>	1.000	Sec	CHG	
Transfer function		CHG	LINEAR				<	>	LINEAR		CHG
Burnout mode		CHG	Upscale				<	>	Upscale		CHG
CJC switch		CHG	CJC ON				<	>	CJC ON		CHG
Term unit		CHG	degF				<	>	degC		CHG
AO type		CHG	-10 to 10 V				<	>	0 to 20 mA		CHG
AO upper range			5.000	V				20.000	mA	CHG	
AO lower range		CHG	1.000	V		<	>	0.000	mA	CHG	

6.4.2. TRANSFERRING DATA TO/FROM DEVICE

Click [Upload] button to connect to the device, to read out its configuration data and to show it in 'Device Configuration' section on the screen (Figure 19). All background colors are back to the initial state.

'Description' indicates the serial number of the product, which cannot be modified or copied from 'File Configuration' section.

Click [Download] button to connect and write the configuration data in 'Device Configuration' fields to the device.

If an error occurs and downloading is stopped during the process, erred data field is highlighted in med pale red background color.

When the downloading is successfully complete, the configuration data is automatically uploaded and the background color returns to the initial state.

Figure 19. Data Uploaded, first page

The screenshot shows the M3LUCFG PC Configurator Ver1.1.2 software interface. The window title is "M3LUCFG PC Configurator Ver1.1.2". The interface is divided into several sections:

- Buttons:** Exit, Page (1), Read File, Write File, Upload (highlighted), Download, Compare, All Copy <<, >> All Copy, Compare.
- Properties:** A section with a blue header containing fields for Description, Tag No., Sensor type, Sensor wires, PV unit, PV upper range, PV lower range, PV damping, Transfer function, Burnout mode, CJC switch, and Term unit. Each field has a "CHG" button to its left.
- File Configuration:** A section with a yellow header containing fields for Description, Tag No., Sensor type, Sensor wires, PV unit, PV upper range, PV lower range, PV damping, Transfer function, Burnout mode, CJC switch, and Term unit. Each field has a "CHG" button to its left.
- Device Configuration:** A section with a yellow header containing fields for Description, Tag No., Sensor type, Sensor wires, PV unit, PV upper range, PV lower range, PV damping, Transfer function, Burnout mode, CJC switch, and Term unit. Each field has a "CHG" button to its right.

The data shown in the Device Configuration section is as follows:

Field	Value
Description	OJ017353
Tag No.	TAGNO123
Sensor type	Type K
Sensor wires	2 Wires
PV unit	degC
PV upper range	100.000 degC
PV lower range	0.000 degC
PV damping	1.000 Sec
Transfer function	LINEAR
Burnout mode	Upscale
CJC switch	CJC ON
Term unit	degC
AO type	0 to 20 mA
AO upper range	20.000 mA
AO lower range	0.000 mA

6.4.3. READING/WRITING FILES

Click [Read File] button to read the configuration data from a specified file and to show it in 'File Configuration' section on the screen (Figure 20). All background colors are back to the initial state.

Click [Write File] button to write the configuration data in 'File Configuration' section to a specified file.

A comment (max. 64 alphanumeric characters) can be entered in 'Description' in File Configuration section, which is saved in a configuration file. It cannot be written in the device. When a setting is uploaded from device, the relevant field in Device Configuration shows the device's serial number.

Figure 20. File Read Out

The screenshot shows the M3LUCFG PC Configurator Ver1.1.2 software interface. The window title is "M3LUCFG PC Configurator Ver1.1.2". The interface is divided into several sections:

- Buttons:** Exit, Page (1), Read File (highlighted), Write File, Upload, Download, Compare, All Copy <<, >> All Copy, Compare.
- Properties:**
 - File Configuration:**
 - Description: CHG, OJ017353
 - Tag No.: CHG, TAG TEST1
 - Sensor type: CHG, Type K
 - Sensor wires: CHG, 2 Wires
 - PV unit: CHG, degC
 - PV upper range: CHG, 500.000, degC
 - PV lower range: CHG, 0.000, degC
 - PV damping: CHG, 1.000, Sec
 - Transfer function: CHG, LINEAR
 - Burnout mode: CHG, Downscale
 - CJC switch: CHG, CJC ON
 - Term unit: CHG, degC
 - Device Configuration:**
 - Description: OJ017353, CHG
 - Tag No.: TAGNO123, CHG
 - Sensor type: Type K, CHG
 - Sensor wires: 2 Wires, CHG
 - PV unit: degC, CHG
 - PV upper range: 100.000, degC, CHG
 - PV lower range: 0.000, degC, CHG
 - PV damping: 1.000, Sec, CHG
 - Transfer function: LINEAR, CHG
 - Burnout mode: Upscale, CHG
 - CJC switch: CJC ON, CHG
 - Term unit: degC, CHG
- AO Configuration:**
 - AO type: CHG, -10 to 10 V
 - AO upper range: CHG, 5.000, V
 - AO lower range: CHG, 1.000, V

6.4.4. COMPARING FILE TO DEVICE

You can compare the configuration data in 'File Configuration' fields and 'Device Configuration' fields.

Click [Compare] button in 'Device Configuration' fields to compare its data to those in 'File Configuration' fields. Deviations will be highlighted in med pale red background color.

Click [Compare] button in 'File Configuration' fields to compare its data to those in 'Device Configuration' fields. Deviations will be highlighted in med pale red background color.


Figure 21. Parameters Compared

Properties	File Configuration				Device Configuration			
Description	CHG	OJ017353		<	>	OJ017353		CHG
Tag No.	CHG	TAG TEST1		<	>	TAGNO123		CHG
Sensor type	CHG	Type K		<	>	Type K		CHG
Sensor wires	CHG	2 Wires		<	>	2 Wires		CHG
PV unit	CHG	degC		<	>	degC		CHG
PV upper range	CHG	500.000	degC	<	>	100.000	degC	CHG
PV lower range	CHG	0.000	degC	<	>	0.000	degC	CHG
PV damping	CHG	1.000	Sec	<	>	1.000	Sec	CHG
Transfer function	CHG	LINEAR		<	>	LINEAR		CHG
Burnout mode	CHG	Downscale		<	>	Upscale		CHG
CJC switch	CHG	CJC ON		<	>	CJC ON		CHG
Term unit	CHG	degC		<	>	degC		CHG
AO type	CHG	-10 to 10 V		<	>	0 to 20 mA		CHG
AO upper range	CHG	5.000	V	<	>	20.000	mA	CHG
AO lower range	CHG	1.000	V	<	>	0.000	mA	CHG


6.4.5. OPERATION EXAMPLE BY FILE MANAGEMENT

Operation procedure to change the configuration of the device with file management.


(1) Click [Read File] button to read the configuration data from a specified file

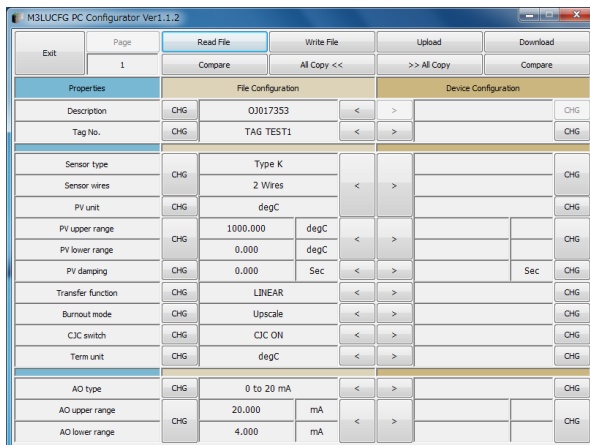

(2) Click [Upload] button to connect to the device, to read out its configuration data.

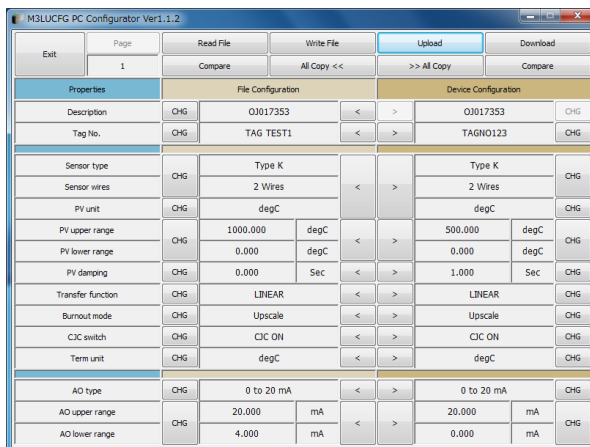

(3) Click [Compare] button in 'File Configuration' fields to compare the data in the file and the data in the device. Deviations will be highlighted in med pale red background color.

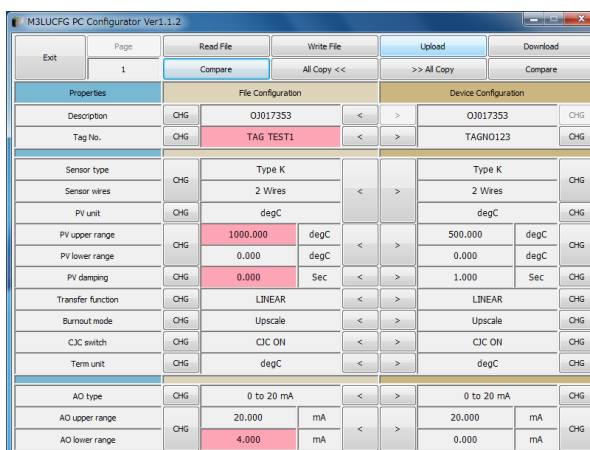

(4) Parameter can be copied from 'File Configuration' to 'Device Configuration' using [>] button. Copied fields will be highlighted in light yellow background color.



(5) Click [CHG] button at the left of each field to modify the parameter. Fields in which the parameter has been changed will be highlighted in light yellow background color.




(6) Click [Download] button to write the configuration data in 'Device Configuration' fields to the connected device. When the downloading is successfully complete, the configuration data is automatically uploaded and the background color returns to the initial state.



7. DIAGNOSTICS

Click [Diagnostics] button to open the Diagnostics window as shown in Figure 22.

Figure 22. Diagnostics

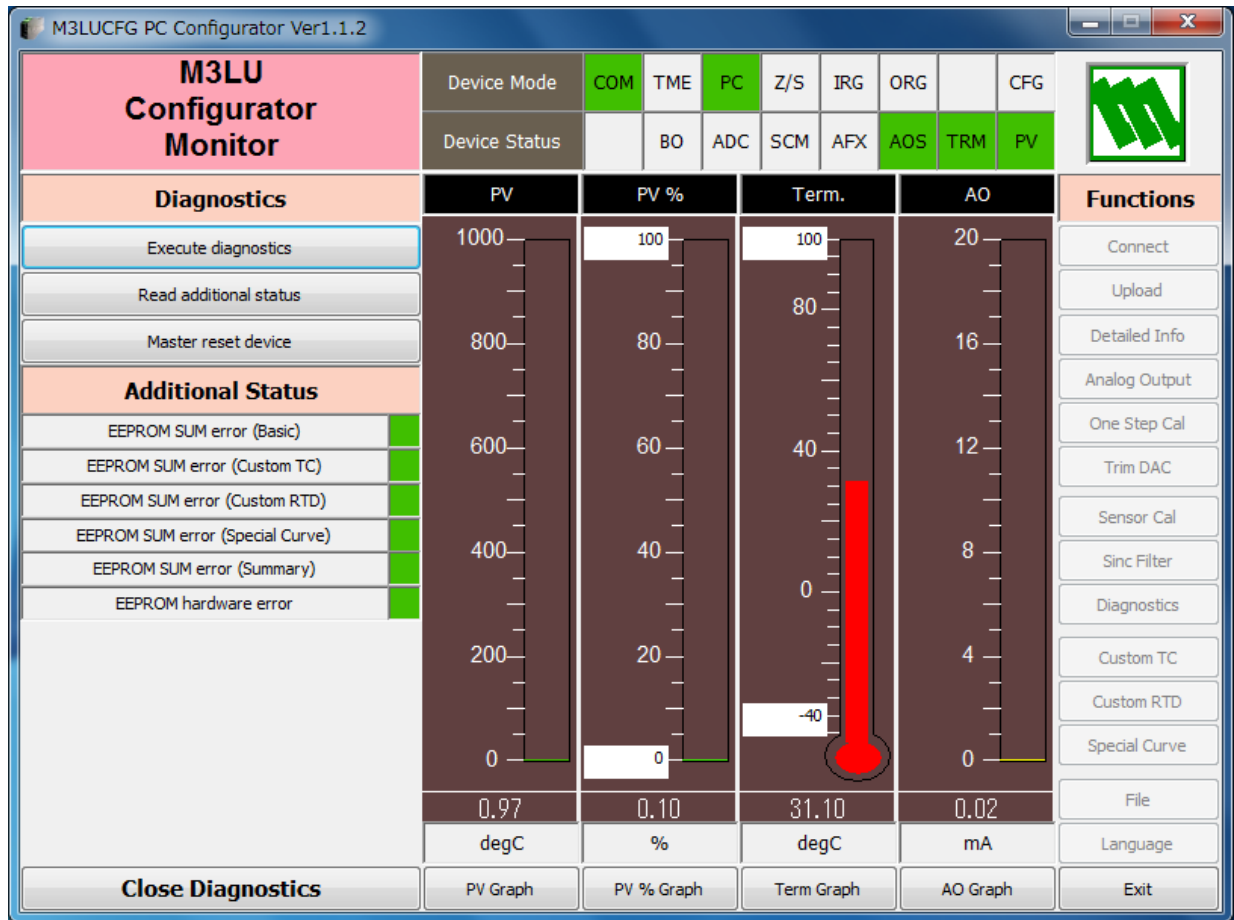


Execute diagnostics		Activates a diagnostics program and results are displayed in Additional Status.
Read additional status		Reads current contents of Additional Status from the device.
Master reset device		Reset and restart the device without actually turning OFF/ON the power supply.
Additional Status	EEPROM SUM error (Basic)	Status is displayed: green in normal status, while red in error.
	EEPROM SUM error (Custom TC)	
	EEPROM SUM error (Custom RTD)	
	EEPROM SUM error (Special Curve)	
	EEPROM SUM error (Summary)	
EEPROM hardware error		
Close Diagnostics		Close the window.

8. LANGUAGE

Click [Language] button to open the Language window as shown in Figure 23. The user can select the display language of the M3LUCFG.

Figure 23. Language

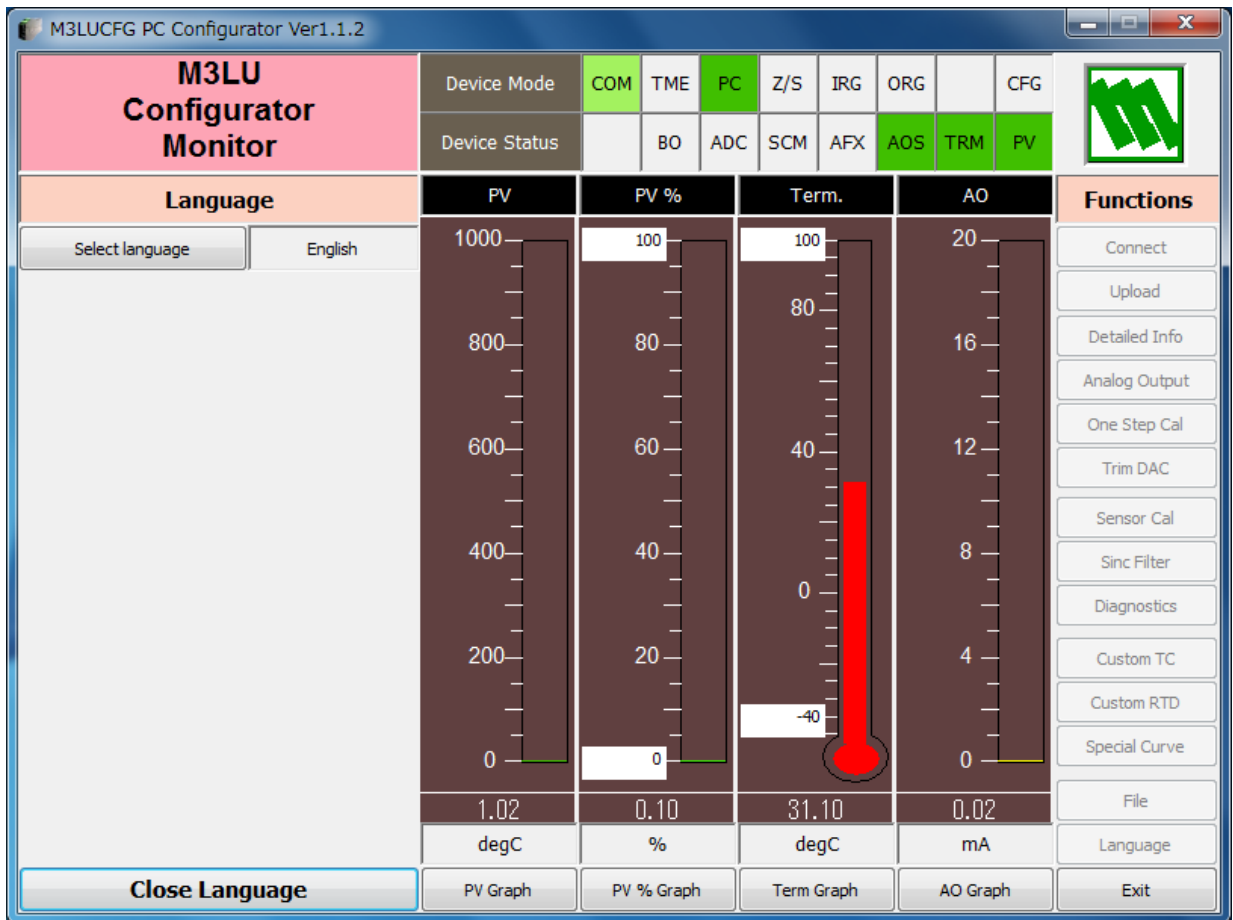

Click [Select language] to select the available language. The selected language is shown on the screen immediately. English is available in each language version of Windows, while Windows in your PC must support other language in order to display it.

Click [Close Language] to close the window.