INSTRUCTION MANUAL

MODBUS I/O MODULE

(4 points, RMS sensing, clamp-on current sensor input)

BEFORE USE

Thank you for choosing us. Before use, please check contents of the package you received as outlined below. If you have any problems or questions with the product, please contact our sales office or representatives.

■ PACKAGE INCLUDES:

| Modbus I/O module(1) | |
|---|--|
| Terminal resistor (110 Ω , 0.25W)(1) | |

MODEL NO.

Confirm Model No. marking on the product to be exactly what you ordered.

■ INSTRUCTION MANUAL

This manual describes necessary points of caution when you use this product, including installation, connection and basic maintenance procedures.

For information on Modbus specification, refer to the Modbus Protocol Reference Guide (EM-5650).

This manuals is downloadable at our web site.

POINTS OF CAUTION

■ CONFORMITY WITH EU DIRECTIVES

- The equipment must be mounted inside the instrument panel of a metal enclosure.
- The actual installation environments such as panel configurations, connected devices, connected wires, may affect the protection level of this unit when it is integrated in a panel system. The user may have to review the CE requirements in regard to the whole system and employ additional protective measures to ensure the CE conformity.

■ POWER INPUT RATING & OPERATIONAL RANGE

• Locate the power input rating marked on the product and confirm its operational range as indicated below: 24V DC rating: 24V ±10%, approx. 90mA

■ GENERAL PRECAUTIONS

• Before you remove the terminal block or mount it, turn off input signals for safety.

ENVIRONMENT

- Indoor use.
- When heavy dust or metal particles are present in the air, install the unit inside proper housing with sufficient ventilation.
- Do not install the unit where it is subjected to continuous vibration. Do not subject the unit to physical impact.
- Environmental temperature must be within -10 to $+55^{\circ}$ C (14 to 131° F) with relative humidity within 10 to 90% RH in order to ensure adequate life span and operation.

■ WIRING

• Do not install cables close to noise sources (relay drive cable, high frequency line, etc.).

• Do not bind these cables together with those in which noises are present. Do not install them in the same duct.


MODEL R10M-CT4E

■ AND

• The unit is designed to function as soon as power is supplied, however, a warm up for 10 minutes is required for satisfying complete performance described in the data sheet.

COMPONENT IDENTIFICATION

FRONT VIEW

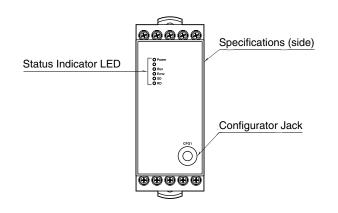

STATUS INDICATORS

| ID | STATUS | COLOR | FUNCTION |
|-------|--------|-------|---------------------------------------|
| Power | ON | Green | Power is supplied. |
| | OFF | | Power is not supplied or an abnormal- |
| | | | ity occurs in the unit. |
| Run | ON | Green | Modbus communication is in normal |
| | | | status. |
| | OFF | | Modbus communication error or during |
| | | | no Modbus communication. |
| Error | ON | Red | Abnormality occurs in the unit. |
| | | | (i.g. memory failure) |
| | OFF | | Normal status. |
| SD | ON | Green | Sending data via RS-485 |
| RD | ON | Green | Receiving data via RS-485 |

■ TERMINAL ASSIGNMENTS

| 1 K1 | 2 K2 | 3 K3 | 4 K4 | 5 NC |
|---------|---------|---------|---------|---------|
| 6 | 7 | 8 | 9 | 10 |
| L1 | L2 | L3 | L4 | NC |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | ЛЛ | | |
| 11 | 12 | 13 | 14 | 15 |
| FE | DB | DA | NC | FE1 |
| 16 | 17 | 18 | 19 | 20 |
| SLD | DG | NC | 24V | 0V |

| PIN NO. | ID | FUNCTION | PIN NO. | ID | FUNCTION |
|------------|----|-----------|------------|-----|---------------------|
| 1 | K1 | Input 1-K | 11 | FE | Modbus grounding |
| 2 | K2 | Input 2-K | 12 | DB | DB |
| 3 | K3 | Input 3-K | 13 | DA | DA |
| 4 | K4 | Input 4-K | 14 | NC | Unused |
| 5 | NC | Unused | 15 | FE1 | Power grounding |
| 6 | L1 | Input 1-L | 16 | SLD | Shield |
| 7 | L2 | Input 2-L | 17 | DG | DG |
| 8 | L3 | Input 3-L | 18 | NC | Unused |
| 9 | L4 | Input 4-L | 19 | 24V | Power supply 24V DC |
| 10 | NC | Unused | 20 | 0V | Power supply 0V DC |

CONFIGURATOR SOFTWARE SETTING

The following parameters can be set with using PC Configurator Software (model: R10CFG) Refer to the users manual for the R30CFG for detailed operation of the software program.

■ INPUT SETTING

Each channel can be set independently.

| ITEM | SETTING RANGE | DEFAULT VALUE |
|-------------------------|---|---------------|
| Clamp-on Current Sensor | CLSE-R5 / CLSE-05 / CLSE-10 / CLSE-20 / CLSE-40 / CLSE-60 | CLSE-R5 |
| Zero Input | CLSE-R5: 0.000 - 5.000 (≤ full input) | 0.000 |
| | CLSE-05: 0.00 - 50.00 (≤ full input) | |
| | CLSE-10: 0.00 - 100.00 (≤ full input) | |
| | CLSE-20: 0.00 - 200.00 (≤ full input) | |
| | CLSE-40: 0.00 - 400.00 (≤ full input) | |
| | CLSE-60: 0.00 - 600.00 (≤ full input) | |
| Full Input | CLSE-R5: 0.000 - 5.000 (≥ zero input) | 0.000 |
| | CLSE-05: 0.00 - 50.00 (≥ zero input) | |
| | CLSE-10: 0.00 - 100.00 (≥ zero input) | |
| | CLSE-20: 0.00 - 200.00 (≥ zero input) | |
| | CLSE-40: 0.00 - 400.00 (≥ zero input) | |
| | CLSE-60: 0.00 - 600.00 (≥ zero input) | |
| Zero Fine Adjust | -320.00 - 320.00 | 0.00 (%) |
| Gain Zero Adjust | -3.2000 - 3.2000 1.0000 | |
| Zero Scaling | -32000 - 32000 0 | |
| Full Scaling | -32000 - 32000 | 10000 |
| Cutout | 0.0 - 5.0 (%) | 1.0 (%) |

■ MODBUS SETTING

| ITEM | SETTING RANGE DEFAU | |
|--------------------------------|---------------------------------|------------|
| Data Mode | Modbus-RTU / Modbus-ASCII | Modbus-RTU |
| Address | 1 - 247 | 1 |
| Baud Rate | 38400 / 19200 / 9600 / 4800 bps | 38400 bps |
| Parity | None / Odd / Even | None |
| Communication timeout duration | n 0.1 - 3200.0 (sec.) 3.0 sec. | |

Depending on data mode and parity bit setting, data bit and stop bit are as following.

| | • • | | |
|--------------|-------------|----------|----------|
| DATA MODE | PARITY BIT | DATA BIT | STOP BIT |
| Modbus-RTU | None | 8 | 2 |
| Modbus-R10 | Odd or Even | 8 | 1 |
| Modbus-ASCII | None | 7 | 2 |
| Modbus-ASCII | Odd or Even | 7 | 1 |

INSTALLATION


The unit can be removed from the base by pulling out while pressing the lockslider on the top thereof.

The base does not come with the unit. Please order separately.

■ DIN RAIL MOUNTING (PARALLEL)


• Mounting the unit

- A) Hook the upper hook at the rear side of the base onto the DIN rail.
- B) Push the lower part of the unit in the direction of the arrow until the base is firmly fixed to the DIN rail.



• Removing the unit

- A) Push down the lower slider using a minus screwdriver.
- B) Pull out the lower part of the unit.
- C) Remove the upper part of the unit from the DIN rail.



■ WALL MOUNTING


Refer to "MOUNTING REQUIREMENTS unit: mm [inch]" on page 3.


Pull out the upper and lower sliders from the base and fix them with M4 screws (Torque: 1.4 $N{\cdot}m)$

TERMINAL CONNECTIONS

Connect the unit as in the diagram below.


EXTERNAL DIMENSIONS unit: mm [inch]

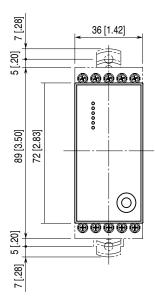

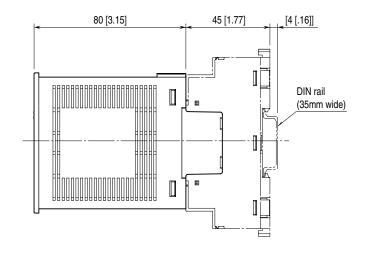


• When mounting, no extra space is needed between units.

■ CONNECTION DIAGRAM

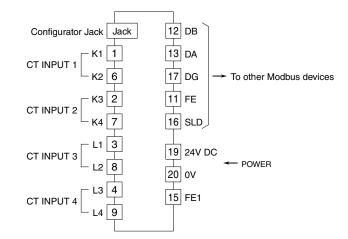

■ INPUT CONNECTION




■ TERMINAL ASSIGNMENT


BASE







MODBUS WIRING CONNECTION

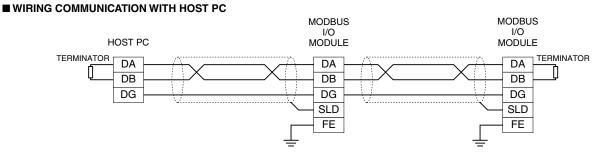

Note: The terminator must be connected across "DA" and "DB" at both ends of communication line.

WIRING INSTRUCTIONS FOR BASE


SCREW TERMINAL

Torque: 0.5 N·m

■ SOLDERLESS TERMINAL

Refer to the drawing below for recommended ring tongue terminal size. Spade tongue type is also applicable. Recommended manufacturer: Japan Solderless Terminal MFG.Co.Ltd, Nichifu Co.,ltd (Solderless terminals with insulation sleeve do not fit)

Applicable wire size: 0.25 to 1.65 mm²



MODBUS FUNCTION CODES & SUPPORTED CODES

Modbus function codes are shown below

■ DATA AND CONTROL FUNCTIONS

| CODE | NAME | |
|------|----------------------|---|
| 02 | Read Input Status | Status of digital inputs to the slave (read only) |
| 04 | Read Input Registers | Collected data from the fi eld by the slave (read only) |

■ EXCEPTION CODES

| CODE | NAME | |
|------|----------------------|--|
| 01 | Illegal Function | Function code is not allowable for the slave |
| 02 | Illegal Data Address | Address is not available within the slave |
| 03 | Illegal Data Value | Data is not valid for the function |

MODBUS I/O ASSIGNMENT

| | ADDRESS | DATA TYPE | DATA |
|---------------------|---------|-----------|--|
| Input (1X) | 1 | | Analog input 1 error (input range error) |
| | 2 | | Analog input 2 error (input range error) |
| | 3 | | Analog input 3 error (input range error) |
| | 4 | | Analog input 4 error (input range error) |
| Input Register (3X) | 1 | I | Analog Input (analog input 1) |
| | 2 | I | Analog Input (analog input 2) |
| | 3 | I | Analog Input (analog input 3) |
| | 4 | I | Analog Input (analog input 4) |

Note: DO NOT access addresses other than the ones mentioned above. Such access may cause problems such as malfunction.

■ DATA TYPE

I: Integer, 0 - 65535

■ STATUS

1 bit: indicates input status.

input range error ((Input range is out of the range)


- 0: Normal
- 1: Error

I/O DATA DESCRIPTIONS

■ ENGINEERING UNIT CONVERSION

CLSE-R5 is multipled by 1000, CLSE-10 and CLSE-20 is multipled 100, CLSE-40 and CLSE-60 is multipled by 10, expressed in 16 bits (0 - 65535).

SCALED ANALOG DATA (16-bit) CONVERSION



The data is 0 to 10000 for scaling 0 to 100% setting.

If the input range is 0 to +105% (0 to +10500) and that is out of range, the data is fixed to 0 or 10500.

■ DATA ERROR STATUS

Data error status is indicated by 1 bit. 0: OFF

1: ON

LIGHTNING SURGE PROTECTION

We offer a series of lightning surge protector for protection against induced lightning surges. Please contact us to choose appropriate models