

TOTALIZED PULSE INPUT MODULE, 4 points
(NPN / PNP / Voltage pulse input)

MODEL **R8-PA4**

BEFORE USE

Thank you for choosing us. Before use, check the contents of the package you received as below.

If you have any problems or questions with the product, please contact our sales office or representatives.

■ **PACKAGE INCLUDES:**

Pulse input module (1)

■ **MODEL NO.**

Confirm that the model number described on the product is exactly what you ordered.

■ **INSTRUCTION MANUAL**

This manual describes necessary points of caution when you use this product, including installation, connection and basic maintenance procedures.

POINTS OF CAUTION

■ **CONFORMITY WITH EU DIRECTIVES**

- The equipment must be mounted inside a panel.
- The actual installation environments such as panel configurations, connected devices and connected wires may affect the protection level of this unit when it is integrated in a panel system. The user may have to review the CE requirements in regard to the whole system and employ additional protective measures to ensure CE conformity.

■ **GENERAL PRECAUTIONS**

- Before you remove or mount the unit, turn off the power supply and input signal for safety.
- Switches on the side of the module can be set for maintenance only while the power supply is off. Do not access them while the power is supplied.

■ **ENVIRONMENT**

- Indoor use
- When heavy dust or metal particles are present in the air, install the unit inside proper housing with sufficient ventilation.
- Do not install the unit where it is subjected to continuous vibration. Do not apply physical impact to the unit.
- Environmental temperature must be within -10 to +55°C (14 to 131°F) with relative humidity within 30 to 90% RH in order to ensure adequate life span and operation.

■ **WIRING**

- Do not install cables close to noise sources (relay drive cable, high frequency line, etc.).
- Do not bind these cables together with those in which noises are present. Do not install them in the same duct.

■ **EXCITATION SUPPLY**

Power output (input terminal): Rated current 0.1A DC per channel (rated current 3 A for internal fuse (slow blow fuse i^2t (A²sec) max. 0.31) , Total 0.4 A DC


■ **AND**

- The unit is designed to function as soon as power is supplied, however, a warm up for 10 minutes is required for satisfying complete performance described in the data sheet.


INSTALLATION

■ **HOW TO MOUNT THE MODULE ON DIN RAIL**


• **I/O Module**

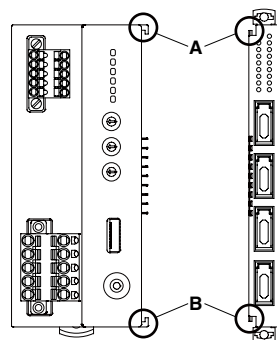


Confirm that the locking clamps of the I/O module are set. Insert the module in parallel to the next one while aligning the grooves of both modules (A & B in the above figure). Maintain it perpendicularly to the rail.

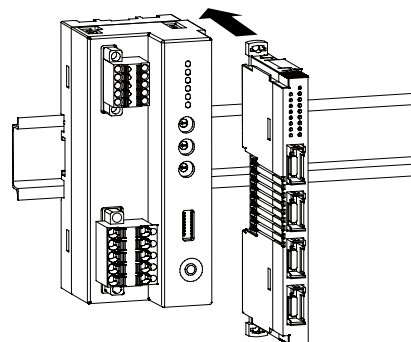


More I/O modules can be added in the same manner.

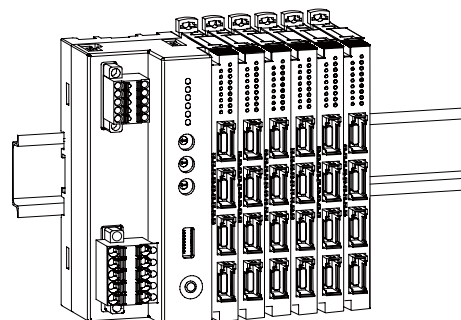


• Protective Cover

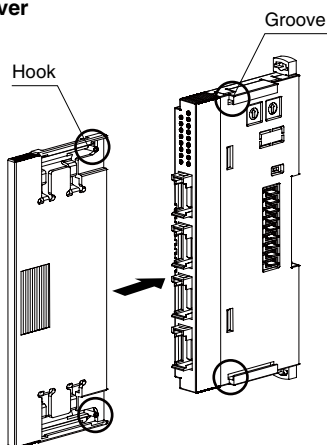

The protective cover is to be attached over the connected I/O module at the right end.
Align the hooks on the cover with the grooves of the module and slide it straight until the hooks are latched.


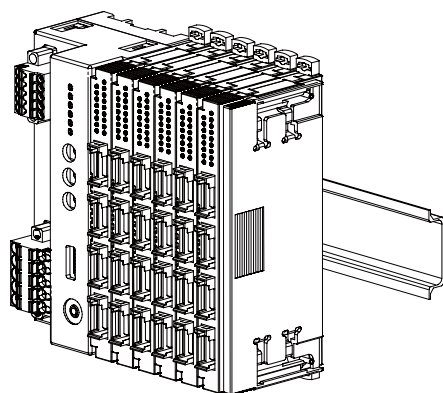


When removing the cover, pull it out while squeezing the hooks inward.


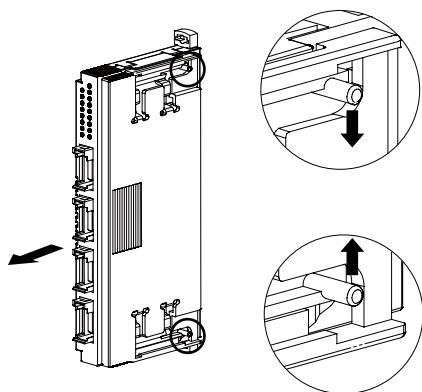


■ HOW TO UNMOUNT THE MODULE ON DIN RAIL

Release the locking clamps and pull out straight the module.

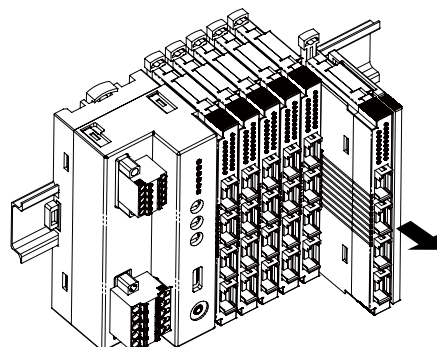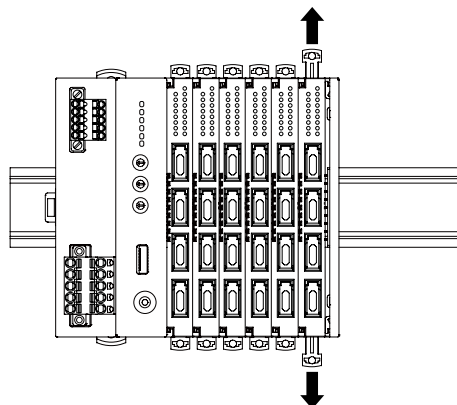

• Removing an intermediate module

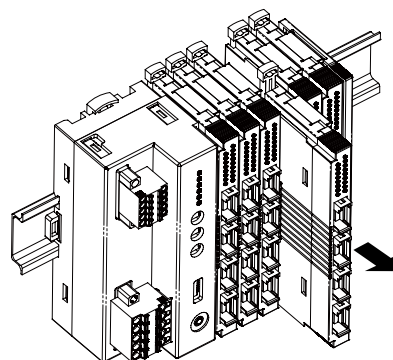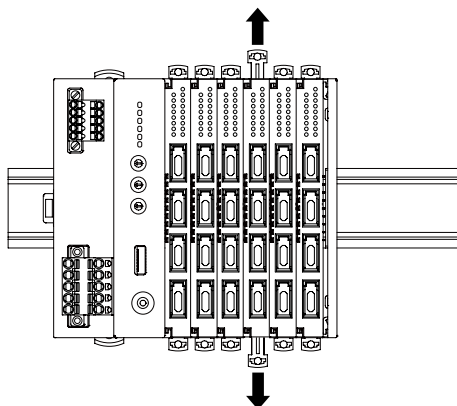


Caution !


- 1) Be careful not to hurt your hand by pointed edges of the internal communication bus connector.
- 2) I/O modules cannot hold tightly on the DIN rail by themselves without power/network module.
Secure them to the position if necessary by using DIN rail end plates.

COMPONENT IDENTIFICATION

FRONT VIEW

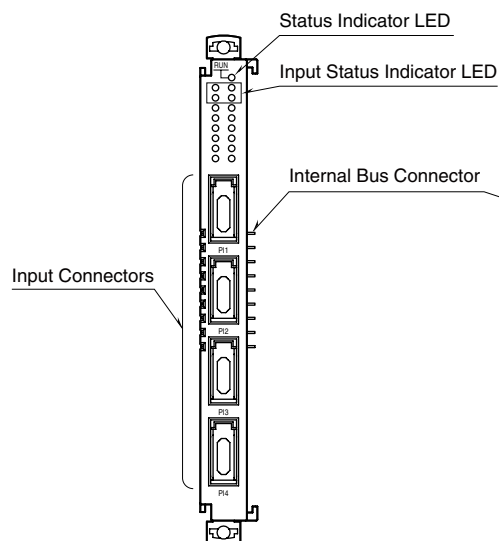


SIDE VIEW

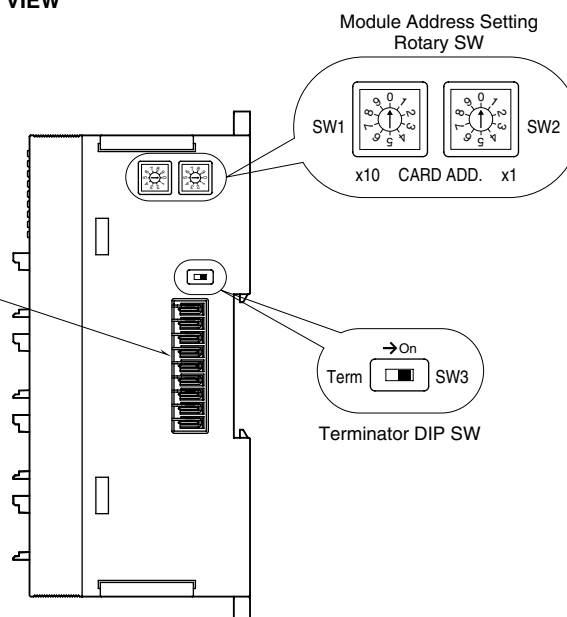

INDICATOR LED

LED	OPERATION	FUNCTION
Status	OFF	Stopping
	Green ON	Valid host communication
	Green Blinking	Reading/writing configuration
	Red ON	Setting error
Input Status	Red Blinking	Parameter error
	OFF	OFF
	Green ON	ON

INPUT CONNECTOR ASSIGNMENT



•R8-PA4A

PIN No.	ID	FUNCTION
1	24V	Excitation supply 24 V
2	NC	No connection
3	0V (COM)	Excitation supply 0 V (COM)
4	PI	Discrete input

•R8-PA4B


PIN No.	ID	FUNCTION
1	24V (COM)	Excitation supply 24 V (COM)
2	NC	No connection
3	0V	Excitation supply 0 V
4	PI	Discrete input

•R8-PA4C

PIN No.	ID	FUNCTION
1	COM	Voltage input (-)
2	NC	No connection
3	0V	0V
4	PI	Voltage input (+)

Module Address

The left switch determines the tenth place digit, while the right switch does the ones place digit of the address. Address is selected between 0 to 28.
(Factory setting: 0)



Module Address Setting (x1)

Module Address Setting (x10)

TERMINATOR DIP SW

TERMINATOR SW	SW3
Without (*)	OFF
With	ON

(*) Factory setting


PC CONFIGURATOR

The following parameters can be set with using PC Configurator Software (model: R8CFG):


- Pulse count setting (accumulated pulse count preset, max. accumulable pulse or overflow reset value)
- Common setting (loss of internal bus communication detection time)

Settings are programmed by the PC Configurator via the Power/Network Module. Refer to the users manual for the R8CFG for detailed operation of the software program.
(Default setting for initial count value: 0, default setting for max. accumulable pulse: 4,294,967,295, default setting for overflow reset value: 0)

EXTERNAL DIMENSIONS unit: mm (inch)

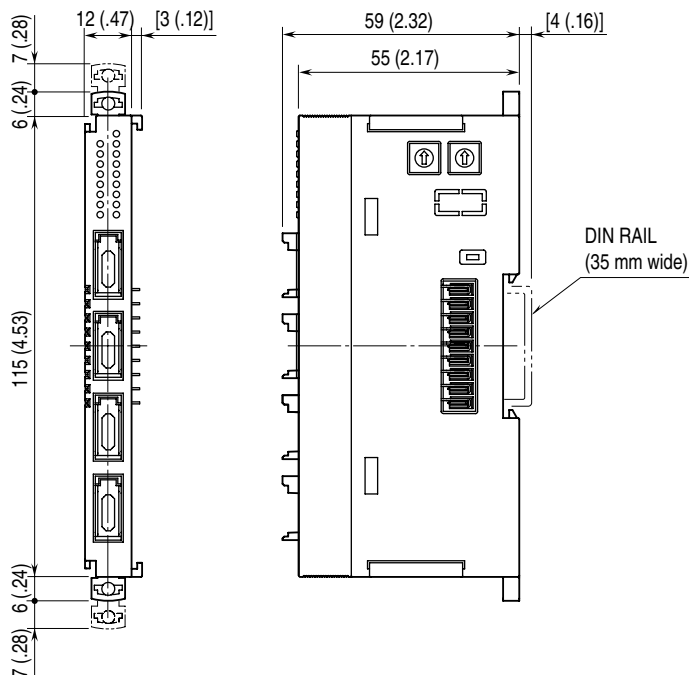

CONNECTION DIAGRAM

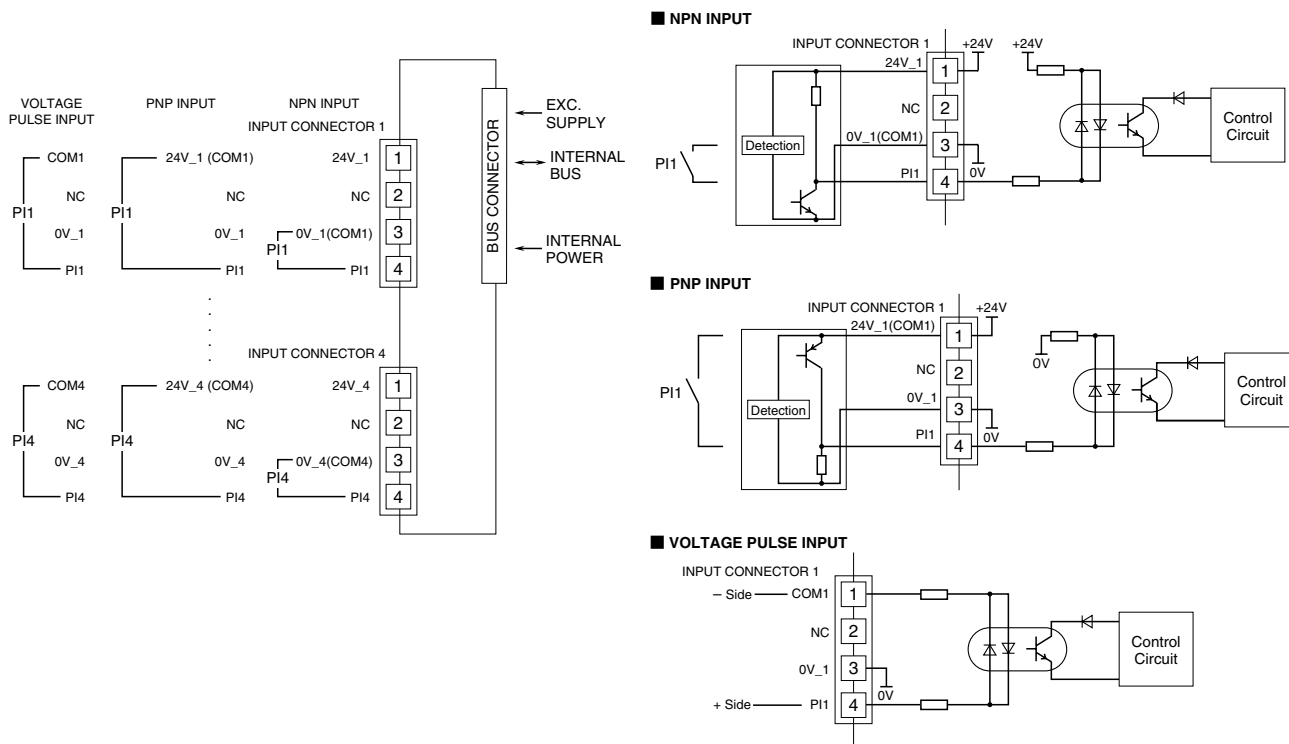

WIRING INSTRUCTIONS

■ e-CON connector (discrete input)

PWB connector XN2D-1474-S002 (Omron)

Recommended cable connector XN2A-1470 (Omron)*1

Applicable wire size: 0.08 mm² (AWG28) - 0.5 mm² (AWG20)

Outer sheath diameter: max. 1.5 dia

*1. The cable connector is not included in the package.

Refer to the specifications of the product.